

# Overview of Power Management Strategies of Hybrid AC/DC Microgrid

Farzam Nejabatkhah, *Student Member, IEEE* and Yun Wei Li, *Senior Member, IEEE*

**Abstract**— Today, conventional power systems are evolving to modern smart grids, where interconnected microgrids may dominate the distribution system with high penetration of renewable energy and energy storage systems. The hybrid AC/DC systems with DC and AC sources/loads are considered to be the most possible future distribution or even transmission structures. For such hybrid AC/DC microgrids, power management strategies are one of the most critical operation aspects. This paper presents an overview of power management strategies for a hybrid AC/DC microgrid system, which includes different system structures (AC-coupled, DC-coupled, and AC-DC-coupled hybrid microgrids), different operation modes, a thorough study of various power management and control schemes in both steady state and transient conditions, and examples of power management and control strategies. Finally, discussion and recommendations of power management strategies for the further research are presented.

**Index Terms**— AC-coupled hybrid microgrid, AC-DC-coupled hybrid microgrid, Control strategies, DC-coupled hybrid microgrid, Energy management, Hybrid AC/DC microgrid, Power management schemes.

## I. INTRODUCTION

Smartgrids are being developed as the next generation power systems. These smart grids encompass interconnected microgrids, especially at the distribution level where distributed generations (DGs) are increasingly used. The DG technologies can be classified into power generation from renewable energy (RE) resources such as wind, photovoltaic, micro hydro, biomass, geothermal, ocean wave and tides, the clean alternative energy (AE) generation technologies such as fuel cells and microturbines, as well as the traditional rotational machine based technologies such as diesel generators. Due to several benefits of these sources such as cleanness and simple technologies, compounded with increasing demands for electrical energy and the exhaustible nature of fossil fuels, the RE and AE-based DGs play an important role in microgrids.

The microgrids can work in grid-connected or stand-alone operation modes. Particularly the stand-alone operation, although may only for very limited period, can provide improved reliability to the smart grids. Some other systems,

such as electric vehicles can be considered as always operating in stand-alone mode. Due to the intermittent nature of renewable energy resources, other energy sources (such as diesel) and storage elements (SEs) are critical part to enable the stand-alone operation of microgrids or to smooth the microgrid power during grid connected operation. SEs can be classified into two categories: capacity-oriented energy storage and access-oriented energy storage [1]-[3]. Capacity-oriented energy storage does not have fast response time and they are used for long-term energy balancing to buffer out low-frequency power oscillation of DGs output power and compensate intermittency of renewable energy sources in microgrids [4]. Batteries, pumped hydroelectric systems, compressed air energy storage (CAES), and hydrogen storage are types of capacity-oriented energy storage. Access-oriented storage devices have fast response time and they are responsible for short time disturbances in microgrids, by providing the high-frequency component of power. They can supply or absorb the high-power transients with high power density [4]. Flywheels, supercapacitors, and superconducting magnetic energy storage (SMES) are considered as access-oriented storage devices.

Due to the presence of DC power sources in microgrids such as PV, fuel cell, and energy storages, and modern DC loads, and considering the existing century-long AC power systems, interests on hybrid AC/DC microgrids are growing rapidly. These hybrid AC/DC microgrids contain AC/DC loads and power sources, have advantages of both AC and DC power systems, and are considered to be the most possible future distribution and transmission systems [5]-[7]. One critical aspect of the operation of such a hybrid AC/DC microgrid is the control strategy and power management scheme, which are essential for providing sound operation in both grid-connected and stand-alone operation modes. In microgrids, the terms “energy management” and “power management” are different considering control tasks and time scale. The global objective of long-term energy management algorithms is matching the total power production to the demand in an optimal way [8], [9]. These algorithms deal with monitoring and operation of a complex system of electrical, thermal, and mechanical components with emphasis on desired and longer term outcomes. Factors like fuel costs, capital costs, maintenance costs, mission profiles, lifetimes, etc. are considered in energy management algorithms. In general, the energy management strategies include hourly prediction of renewable energy sources, management of controllable loads, providing appropriate level of power reserve capacity, etc. [9].

Manuscript received July 10, 2014; revised September 1, 2014; accepted December 8, 2014.

F. Nejabatkhah and Y. W. Li are with the Department of Electrical and Computer Engineering, University of Alberta, Edmonton, AB T6G 2V4 Canada (e-mail: [nejabatk@ualberta.ca](mailto:nejabatk@ualberta.ca); and [yunwei.li@ualberta.ca](mailto:yunwei.li@ualberta.ca)).

On the other hand, the objective of short-term power management strategy is to affect the instantaneous operational conditions towards certain desired parameters such as voltage, current, power and frequency. The power management strategies include voltage and frequency regulations, and real-time power dispatching among different power sources in microgrids [9]. As the short term power management is more relevant to the interface and control of power converters in the microgrid and is therefore the focus of this paper.

While the control strategies and power management schemes for the traditional AC microgrid or DC microgrid are well understood with active research in recent years, the operation and power management of a hybrid AC/DC microgrid system has not been well studied so far. This paper presents an overview of control strategies and power management schemes for hybrid AC/DC microgrid. First, different hybrid AC/DC microgrid structures are discussed, including real world implement examples. Then, the control strategies and power management schemes of different types of hybrid AC/DC microgrid under different operation conditions are discussed. A few representative implementation examples of control strategies are also presented. Finally, recommendations for the future research on the control and power management of hybrid AC/DC microgrid are provided.

## II. HYBRID AC/DC MICROGRID STRUCTURES

In this paper, the term “Hybrid AC/DC Microgrid” refers to a microgrid which contains both AC/DC power sources and AC/DC loads. Depending on how the sources and loads are connected to the system and how the AC and DC buses are configured, the structure of hybrid AC/DC microgrids can be classified into AC-coupled, DC-coupled and AC-DC-coupled microgrids. In AC-coupled hybrid microgrids, various DGs and SEs are connected to the common AC bus through their interfacing converters. In DC-coupled hybrid microgrids, DGs and SEs are connected to the common DC bus, and an Interfacing Converter (IFC) is used to link the DC and AC buses. In AC-DC-coupled hybrid microgrids, DGs and SEs are connected to DC and AC buses, where these buses are linked by Interlinking Converter (ILC). In this section, these microgrid structures and their real world implement examples are provided.

### A. AC-Coupled Hybrid Microgrid

In an AC-coupled hybrid microgrid, shown in Fig. 1, various DGs and SEs are connected to the common AC bus through their interfacing converters. The SEs need bidirectional converters to provide the bidirectional power flow capability. In this structure, AC and DC loads are also connected to the common bus (with or without power electronic converters). This structure is commonly used when dominant generation sources in the microgrid produce grid level AC voltages directly (such as from diesel generator) or indirectly through interfacing power converters.

In such an AC-coupled system, the control strategy and power management scheme is mainly focused on power generation/consumption balance and the AC bus

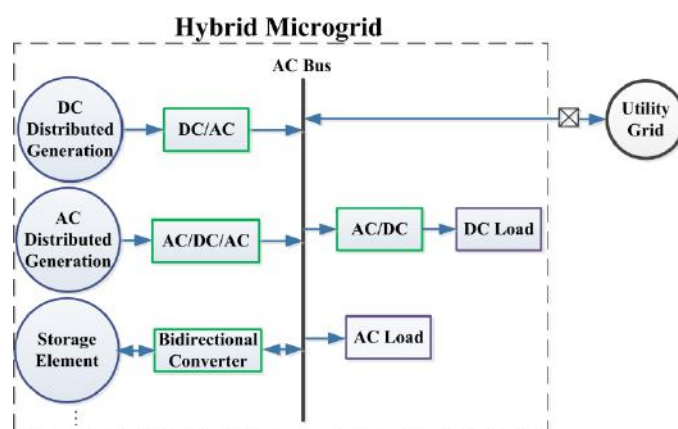


Fig. 1 AC-coupled hybrid microgrid.

voltage/frequency control, especially in standalone operation mode.

The AC-coupled microgrid is the dominant structure now due to its simple structure and simple control and power management scheme. Around the world, most implemented hybrid AC/DC microgrids are AC-coupled. Some of them are:

- Hachinohe microgrid in Japan [10]-[12]. In this microgrid, a gas engine system ( $3 \times 170kW$ ), several PV systems ( $2 \times 50kW$  one plant and  $3 \times 10kW$  dispersed), a small wind farm ( $2 \times 2kW$  one plant and  $2 \times 8kW$  dispersed), and  $100kW$  battery storage are connected to the AC distribution line. This microgrid provides electrical power for four schools and a water supply authority office. The control and energy management scheme balance supply and demand powers by weekly planning, economic dispatch control once every 3 min, and second-by-second power flow control at interconnection points.
- Bronsbergen Holiday Park Netherland [11], [13]. This low voltage AC-coupled microgrid project, consisting of 208 homes, was supported by European Union. In this microgrid, PV units with the peak generation capacity of  $315kW$  are connected to common AC bus through the interfacing inverters. Two battery banks, as a central energy storage system, are connected at the point of common coupling. For energy management, the central control receives all the system data, and controls active and reactive power of sources.
- Kythnos Greece [11], [14]. In this microgrid,  $10kW$  PV, a  $53kWh$  battery bank, and a  $5kW$  diesel generator are connected to the common AC bus, and electrify 12 houses. In this system, other  $2kW$  PV array and  $32kWh$  battery bank are used to provide power for monitoring and communication systems. Residential service is powered by three parallel battery inverters using frequency droop control method in which grid frequency is used as communication signal.
- Aichi microgrid in central Japan airport city [11], [15]. In this system, two molten carbonate fuel-cells (MCFCs) ( $270kW$  and  $300kW$ ), one  $25kW$  solid oxide fuel-cell

(SOFC), four phosphoric acid fuel cells (PAFCs) with the capacities of 200kW, 330kW PV, and a sodium-sulfur (NaS) battery storage system are connected to AC bus through their interfacing converters. In this AC-coupled microgrid, matching the supply and demand power and voltage control is done by the battery converter. In addition, optimization technique (genetic algorithm and a tabu search called a meta-heuristic technique) are used for a day-ahead generation planning.

In some AC-coupled microgrids, instead of using interfacing converters for each DG or SE, several power conversion stages can be replaced by multiple-port converters which combine different power sources in a single power converter. As a result, the whole system can be viewed as a single power processing stage that has multiple interfacing ports. In these systems, input power sources are usually connected to a high-frequency AC link, and isolation transformer plus AC/DC/AC interfacing converters are utilized to connect the generation into the load/grid [16]-[20].

### B. DC-Coupled Hybrid Microgrid

Fig. 2 shows a DC-coupled hybrid microgrid, where DGs and SEs are connected to the common DC bus, and interfacing converters (IFCs) are used to link the DC and AC buses. This structure can be used when DC power sources are major power generation units in the microgrid. Note that in this structure, all the DGs and SEs are connected to the DC bus. If there are DGs and SEs on AC bus, it would be an AC-DC-coupled hybrid microgrid as will be discussed later. In this DC-coupled microgrid, variable frequency AC load such as adjustable speed motors can be connected to DC bus with a DC/AC converter (to avoid the extra AC/DC conversion for AC bus connection). In this system, IFCs provide bidirectional power flow between AC and DC buses. Depending on the power exchange requirement between DC and AC buses, parallel IFCs are typically used with increased rating and reliability.

The DC-coupled microgrid features simple structure and does not need any synchronization when integrating different DGs. However, the control and power management of parallel IFCs, and their output voltage synchronization (with each other or with the grid in grid-connected mode) can present some

challenges. Moreover, both DC and AC voltage control and subsystem power management are necessary in a DC-coupled system. In some DC-coupled hybrid microgrids, SEs are connected to DC bus directly without converters, which introduce different control schemes. These methods will be discussed in Section III.

In DC-coupled hybrid microgrids, various projects have been implemented around the world. Some of them are presented in following:

- CESI RICERCA DER microgrid in Italy [21]. This low voltage DC-coupled microgrid is connected to 23kV medium voltage grid through a 800kVA transformer. This microgrid consists of several generators, controllable loads and storage systems, and can provide maximum power of 350kW to the main grid. The system contains of PV, different kinds of batteries, a diesel engine coupled with an asynchronous generator, a simulated asynchronous wind generator, solar thermal plant, CHP system fuelled by biomass, CHP plant with a gas microturbine, flywheel, and loads in DC bus, which is connected to AC bus through interlinking inverter. In this microgrid, central control scheme, which uses optimization techniques, controls the set-points of each source.
- Kahua Ranch Hawaii Hydrogen Power Park in USA [22]. In this DC-coupled hybrid microgrid, PV (10kW), wind turbine (7.5kW), battery (85kWh), and fuel cell (5kW) are connected to DC bus through their converters. The electricity generated by the wind turbine and solar array are used to power electrolyzer to make hydrogen, which is stored without further compression. In case that electricity is needed, the hydrogen is supplied to a fuel cell to produce electrical power. In addition, the stored hydrogen could also be used to fuel an internal combustion engine which would power an electric generator.

Similar to AC-coupled hybrid microgrid, in DC-coupled hybrid microgrids multiple-port power converters can be used to connect different input power sources to a common DC link in a unified structure [23]-[25].

### C. AC-DC-Coupled Hybrid Microgrid

The structure of an AC-DC-coupled hybrid microgrid is shown in Fig. 3. As seen from this figure, both DC and AC buses have DGs and SEs, and these buses are linked by interlinking converters (ILCs). Different from the DC-coupled system, the AC-DC-coupled hybrid microgrid has DGs and SEs on AC bus too, which requires more coordination for the voltage and power control between the DC and AC subsystems. On the other hand, similar to DC-coupled microgrid, parallel ILCs are desired to link AC and DC buses with increased capacity and reliability. In general, this structure is considered if major power sources include both DC and AC powers. This structure improves overall efficiency and reduces the system cost with reduced number of power converters by connecting sources and loads to the AC and DC buses with minimized power conversion requirements. Considering these benefits, AC-DC-coupled hybrid microgrids will be the most promising

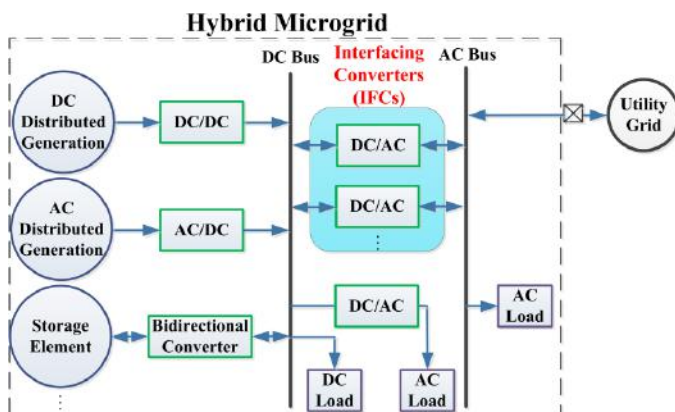


Fig. 2 DC-coupled hybrid microgrid.



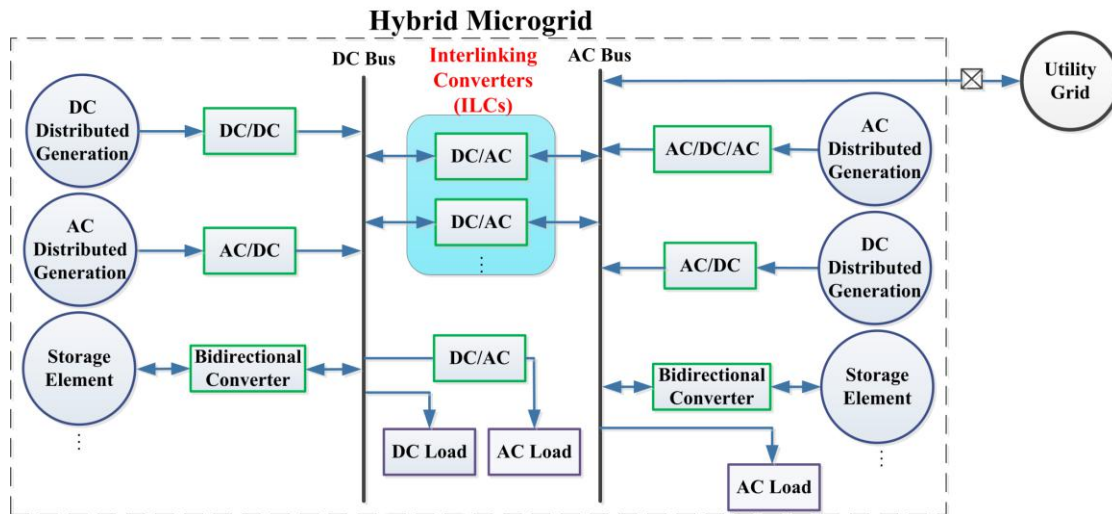


Fig. 3 AC-DC-coupled hybrid microgrid.

microgrid structures in the near future. Europe is leading research efforts in this direction through the European supergrid [26]-[28], in which power of various DC and AC power sources such as offshore wind turbines and desert-based solar are transmitted using AC and DC grids.

Although the idea of AC-DC-coupled hybrid microgrid is promising, it necessitates thorough study and investigations, particularly for the energy and power management aspects. Control of such a system needs to consider both DC and AC bus voltages (and frequency) control, as well as the power balance within the DC and AC subsystems.

### III. CONTROL STRATEGIES AND POWER MANAGEMENT SCHEMES OF HYBRID AC/DC MICROGRIDS

For the operation of hybrid AC/DC microgrids, control strategies and power management schemes are the most important aspects. The power management strategies determine output active and reactive powers of DGs and SEs, and control the voltages and frequency at the same time. Details of strategies for different types of hybrid AC/DC microgrids are explained in this section.

#### A. AC-Coupled Hybrid Microgrid

The control strategies and power management schemes of AC-coupled hybrid microgrid are mainly focused on power balancing within the microgrid, and the AC bus voltage and frequency control especially in stand-alone operation mode. In this structure, DGs and SEs can be treated like parallel AC voltage sources or current sources. The overview of power management schemes for AC-coupled microgrids is shown in Fig. 4. These strategies can be separated into grid-connected and stand-alone operation modes.

In grid-connected mode, the power management strategies can be classified into dispatched power mode (where the power exchange between the microgrid and the main grid is dispatched from a higher level control/optimization scheme) and undispached output power mode (where the microgrid output power is not dispatched). In dispatched output power

mode, the microgrid behaves like a controllable source or load to the main grid and can provide valuable grid support or load management functions as a whole. To realize this, SEs are inevitable. In this mode, DGs and SEs operate on power control mode. The power control can be realized by current control or voltage control. In current control mode, which is popularly used in grid-connected operations, DG's output current is controlled in order to track the reference power, and the output voltage and frequency are determined by the grid. In voltage control mode, which can be used in both grid-connected and stand-alone operation modes, DG's output voltage is controlled to regulate its output power, and DG behaves like a synchronous generator [29]. To produce the dispatched microgrid output power, power balancing schemes within the microgrid are used to share dispatched power among input power sources [30]-[33]. For example, renewable-energy-based DGs can work on their Maximum Power Point (MPP), and other power sources can provide power deficiency between generation and demand considering input power sources operation range, response time, etc. [32], [33]. Power balancing control scheme will be explained in details in Section VI.

In grid-connected undispached output power operation mode, all generated powers are fed to the grid; DGs work on MPP, and SEs are typically charged [34], [35]. Moreover, SEs can be controlled to smooth DGs output power oscillation especially for DGs with intermittent nature such as wind and PV systems.

Moreover, in grid-connected operation mode (both in dispatched and undispached power mode), the microgrid can be used for the grid support (for example, grid voltage and frequency regulations) by controlling active and reactive powers delivered to the grid [36], [37]. This grid support will be included in the dispatched/reference microgrid power in the dispatched power control mode. In undispached power mode, the grid support function will be realized individually through the DG or SE interfacing converters.

In stand-alone operation mode, power management and control schemes are focused on microgrid AC bus voltage and

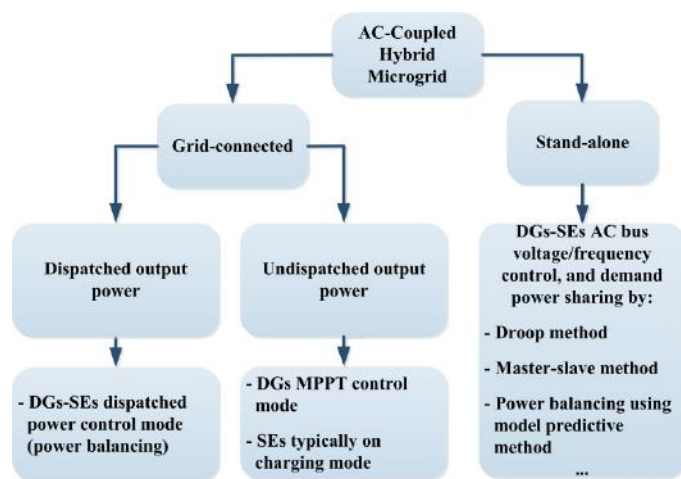


Fig. 4 Overview of power management strategies of the AC-coupled hybrid microgrid.

frequency control, as well as demand power sharing among DGs and SEs. Various schemes have been proposed to realize this. Droop method is probably the most common method in this group which emulates the behavior of synchronous generator where the voltage and frequency vary with the output real and reactive power of DG. This method is used for determining the output active and reactive power of each source in order to regulate the frequency and voltage of AC bus on their desired values [6], [29], [30], [38]-[46]. Other than droop control, DGs can work on their MPP, and SEs control AC bus voltage and frequency [47], [48]. In other words, SEs balance the demand and generated powers in order to regulate frequency and voltage of AC bus. In addition to the above mentioned methods, there are other power management schemes that can be used in stand-alone AC-coupled hybrid microgrids such as power balancing using model predictive method [32], and heuristic methods [8].

In AC-coupled hybrid microgrids, since DGs and SEs are treated like parallel AC voltage sources or current sources, control strategies and power management schemes of parallel AC sources such as master-slave [49]-[51], circular-chain control [52] and average-current control methods [53], [54] can be applied with some minor changes. For example, utilizing master-slave control scheme, one DG unit, which has mainly high output power, works on voltage-controlled operation mode and controls AC bus voltage and frequency (master module) while the other DGs and SEs (slave units) work on current-controlled operation mode and track the current command provided by the master unit.

Many of the above mentioned power management strategies require communication mechanisms to share information among DGs and SEs [55]. For example, power balancing and master-slave methods are communication-based schemes. However, these methods are costly and their reliabilities depend on the effective communications. Communication-less control methods, on the other hand, attract more interests as they are more reliable and enable true plug-and-play of DGs and SEs. For communication-less control, demand power is shared between DGs and SEs without

communication among them. These methods eliminate the physical location limitation of DGs and loads, and improve the microgrid performance. For example, droop control method is the most popular communication-less control scheme. However, without the information of other DGs and loads, very accurate or optimal control of the DGs and SEs is difficult in the communication-less methods. As a result, a combination of both techniques can be a better option for future system. For example, communication-based method combined with droop control as backbone can provide both high performance and reliability. More discussions about communication systems in hybrid microgrid will be provided in Section V.

## B. DC-Coupled Hybrid Microgrid

In DC-coupled hybrid microgrids, the DC link voltage control, power balancing between generation and demand, and AC link voltage and frequency control (especially in stand-alone mode) are the objectives of power management schemes. The overview of the power management and control schemes of DC-coupled hybrid microgrid system is shown in Fig. 5. Similarly, the power management methods can be divided into grid-connected operation and stand-alone operation, where the grid-connected operation has dispatched power mode and undispatched power mode.

In the DC-coupled microgrid, the IFC which connects DC and AC buses can work on bi-directional power control mode, DC link voltage control mode, or AC link voltage control mode [56]-[58]. In power control mode, as explained before, the converter output current or voltage is controlled to regulate IFC output power on its reference value. In DC link voltage control mode, IFC controls DC link voltage and therefore balancing the power generation and consumption on DC bus. This operation mode is used when the control of output power of grid-connected IFC is not required. AC link voltage control mode of IFC is mainly for stand-alone microgrid operation, where the IFC controls the AC subsystem voltage and frequency.

For a grid-connected DC-coupled microgrid, if it is in dispatched power mode, the DC link voltage can be controlled by two methods. In the first method, IFC works on DC link voltage control mode, and regulates DC link voltage at the desired value; in addition, DGs and SEs provide dispatched power of hybrid microgrid through power balancing control [59]-[61]. In the second method, SEs on DC bus control the DC link voltage collectively using droop control method [6], [7], [62]-[64], and the DGs can be part of the droop control or work in MPP [59], [65]-[68]. In this operation mode, IFC operates in power control mode and provides dispatched power to the grid. In undispatched output power operation mode [69], [70], IFC operates in DC link voltage control mode. With the fixed DC bus voltage, DGs work on MPP, and SEs are typically charged or controlled to smooth DGs output power oscillation.

Finally, the grid support functions can be realized in the grid-connected operation. Unlike in AC-coupled microgrid, where the function can be realized by all the DC/AC interfacing converters of DGs and SEs, the grid support is

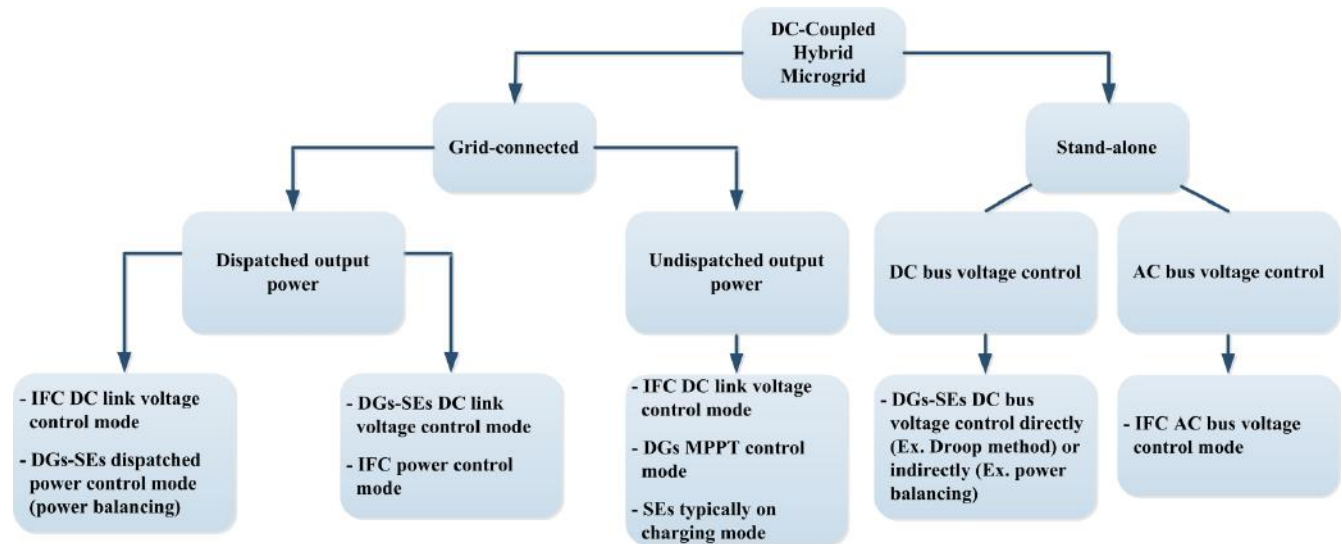


Fig. 5 Overview of power management strategies of the DC-coupled hybrid microgrid.

realized by the IFC between DC and AC bus here in the DC-coupled microgrid.

In stand-alone operation of a DC-coupled hybrid microgrid, DC bus voltage and AC bus voltage and frequency should be controlled simultaneously. For AC bus voltage and frequency control, IFC works on AC link voltage control mode [38], [71] and controls AC bus voltage and frequency. On the other hand, the DC bus voltage can be controlled directly or indirectly. In direct DC link voltage control, DGs and/or SEs regulate DC link voltage on its reference value (with droop control for example) [72]-[78].

In indirect DC link voltage control mode, power balancing between demand and generation regulates DC link voltage [79]. In this operation mode, with the presence of parallel IFCs, it is possible that some of the converters work on AC link voltage control mode and the others control the DC link voltage and balance the generation and demand powers.

In some structures of DC-coupled hybrid microgrids, SEs are directly connected to DC bus. Typically, these SEs are capacity-oriented storage devices such as battery. Since storage elements fix the DC bus voltage, the power management of DC bus is focused on the control of currents. The current and power of DC bus can be controlled by access-oriented storage [80]-[83], capacity-oriented storage [84], or other DGs, which are connected to DC bus with interfacing converters.

### C. AC-DC-Coupled Hybrid Microgrid

In AC-DC-coupled hybrid microgrids, multiple DGs and SEs are connected to AC and DC buses. Therefore, more coordination between the DC and AC subsystems are necessary. In these systems, the control strategies and power management schemes need to consider the power balance and voltage control in both DC subsystem and AC subsystem. An overview of power management schemes of AC-DC-coupled hybrid microgrid is shown in Fig. 6.

Similar to the IFC of DC-coupled microgrid, the interlinking converter (ILC) in an AC-DC-coupled microgrid can be in bi-directional power control mode, DC voltage control mode or AC voltage control mode. However, the coordination between ILC and AC bus DGs and SEs is necessary here in the power and AC bus control modes.

In grid-connected operation mode with dispatched microgrid output power, two methods can be used for DC link voltage control and dispatched power generation. In the first method, ILC works on DC link voltage regulation mode to set the DC bus voltage on its desired value. In this mode, coordination between DGs-SEs on DC bus and DGs-SEs on AC bus is necessary to produce the dispatched output powers. In the second operation mode, DGs-SEs on DC bus regulate DC link voltage on its reference value while ILC and DGs-SEs on AC bus collectively provide the dispatched power [6], [7], [85]. In this operation mode, ILC works on power control mode.

In grid-connected undispatched output power operation mode, DGs in both DC and AC buses work on MPP [86], [87]. In addition, SEs are charged if necessary or discharged for smoothing output power injected to the grid. In this mode, ILC regulates DC link voltage on its desired value and injects all power generated by DGs-SEs in DC bus to the load/grid.

In AC-DC-coupled hybrid microgrid in grid-connected operation modes, similar to other structures of hybrid microgrids, DGs on AC bus together with ILC can be controlled to realize the grid support functions.

In stand-alone operation mode, coordination among ILC, DGs-SEs on AC bus, and DGs-SEs on DC bus is essential to regulate DC bus voltage, AC bus voltage and frequency, and balance microgrid total generation and demand powers at the same time. In this operation mode, the power management strategies of AC-coupled hybrid microgrids in stand-alone operation mode such as droop [29], [38]-[45], master-



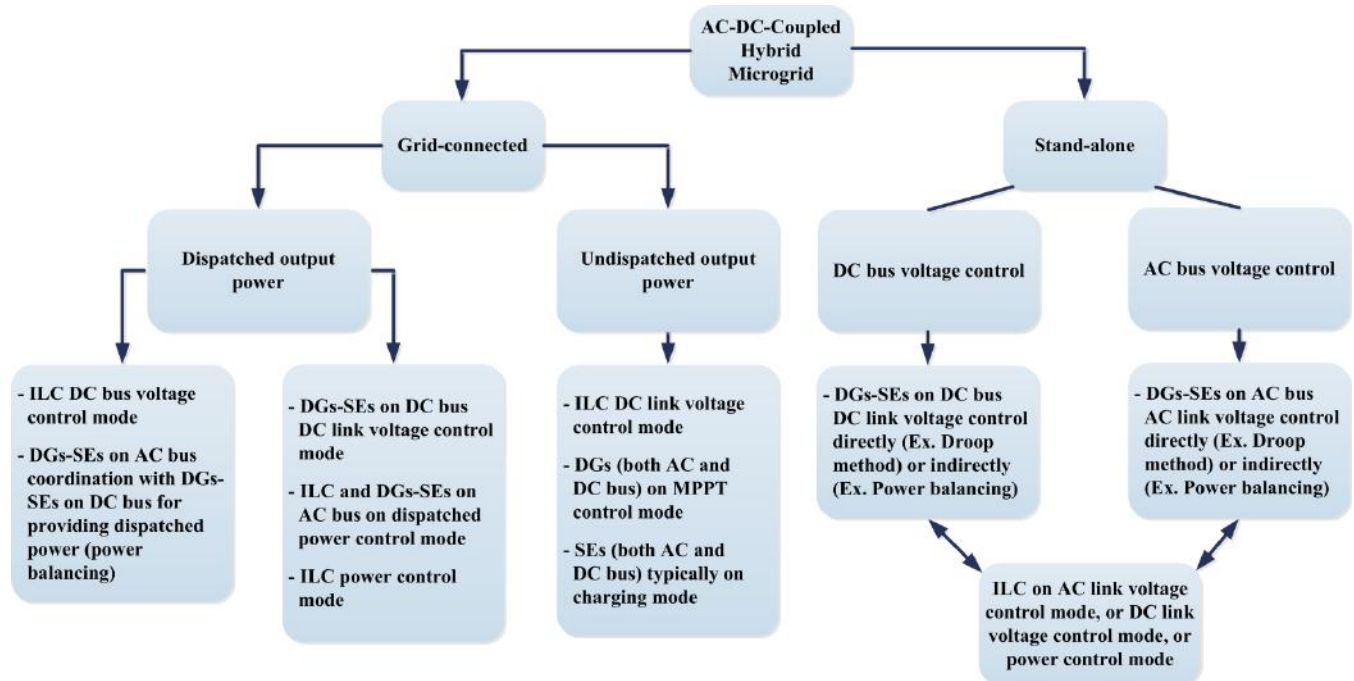


Fig. 6 Overview of power management strategies of the AC-DC-coupled hybrid microgrid.

slave [49]-[51], [87], etc. can be used for AC subsystem voltage and frequency regulation and demand power sharing. For the DC subsystem control, similar to DC-coupled hybrid microgrid in stand-alone operation, DC bus voltage can be controlled by DGs-SEs on DC bus directly [6], [7] (for example, utilizing droop control method in DC bus) or indirectly (for example, utilizing power balancing control strategy) [9], [86], [88].

It is important to note that in stand-alone operation mode, ILC plays an important role in power management and control [6], [7]. Depend on types of control strategies used in AC and DC buses, this converter can be used on DC-bus control mode, AC-bus control mode, or output power control mode as discussed. However, providing coordination among these control strategies (AC-bus, DC-bus, and ILC control strategies) is the most important objective in this operation mode. For example, in the condition that DC bus voltage is controlled by DGs-SEs connected to DC bus, and AC bus voltage is controlled by DGs-SEs connected to AC bus, the ILC is responsible to manage the power flow between AC and DC sides in order to equalize the demand and generated power. Also, in case of parallel ILCs, the ILCs can work on different operation modes: some of them can work on DC link voltage control mode while the others work on AC link voltage control mode or power control mode. More explanation on the ILC control is provided in Section VI.

#### IV. POWER MANAGEMENT STRATEGIES DURING TRANSIENT AND DIFFERENT LOADING CONDITIONS

The above reviewed hybrid microgrid power management strategies are mainly focused on the steady state power balancing and voltage/current control. The power management

strategies during microgrid operation mode transitions and during different loading conditions are reviewed in this section.

##### A. Power Management during Transition between Grid-Connected and Stand-Alone Operation Modes

The transition between grid-connected and stand-alone operating modes should be seamless and smooth to minimise voltage and frequency disturbances and deviations, and ensure balanced power flows to prevent DGs overloading and circulating powers. Here the control strategies for transition from grid-connected to stand-alone operation and transition from stand-alone to grid-connected operation are discussed separately. An overview of these transitions is shown in Fig. 7.

##### 1) Transition from grid-connected to stand-alone operation mode

There are mainly two groups of control strategies for microgrid transition from grid-connected operation to stand-alone operation: a) switch of control strategies from current/power control mode in grid-connected operation to the voltage control mode in stand-alone operation; and b) uniformed control in both grid-connected mode and stand-alone mode.

In the first group, different control strategies are used in grid-connected and stand-alone operation modes, and the control strategy is switched between these two controllers [89]-[93]. Specially, DGs are working on current control mode (MPPT control or dispatched power control) in grid-connected operation mode to inject power to main grids, while voltage control (droop method or conventional voltage control) is used in stand-alone operation mode to ensure supplying continuous power to sensitive loads and sharing the load demand among

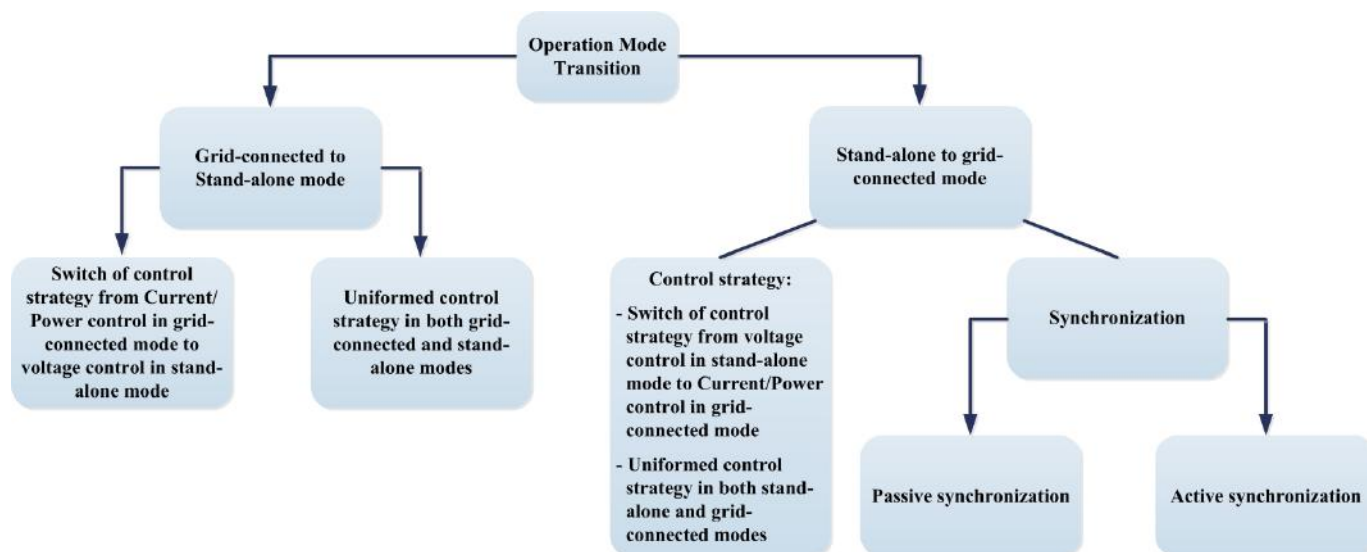


Fig. 7 Overview of power management during transition between grid-connected and stand-alone operation modes.

voltage controlled DGs. This switching of control can be applied to DC/DC converter interfaced DG or energy storage units, DC/AC converter interfaced DG or energy storage units, as well as interfacing or interlinking converters. For a seamless transition, there are a number of recently proposed methods. For example, the line current of DG can be reduced to zero before switching to stand-alone voltage control mode [89], [90]. It is also possible for faster transition without reducing the DG line current to zero. To realize this, the current controller (in grid connected mode) and voltage controller (in stand-alone mode) control states can be carefully coordinated to avoid transient current or voltage spikes during the transition [91]-[93].

To realize this control scheme switch, an islanding detection algorithm (passive, active, and communication-based detection schemes [94], [95]) is usually used to determine the disconnecting time instance which is used to switch the microgrid controller from grid-connected to stand-alone mode. As a result, achieving seamless and smooth transitions can be quite difficult when the islanding detection is delayed. After isolation, the voltage controller is immediately applied, and synchronization unit works as an oscillator at a fixed frequency. In case of multiple DGs, droop control or other stand-alone operation control strategies as reviewed earlier can be applied.

In the second group, the power management and control strategies are the same in both grid-connected and stand-alone operation modes, and it is not necessary to modify the control strategy during the transitions [29], [96]-[104]. Therefore, it is challenging to design and implement a robust control strategy to work on grid-connected, stand-alone, and transient modes. For this group of control methods, islanding detection algorithm is not necessary in theory, but is usually needed due to utility requirements as well as for better control performance. This group may include smaller DG units that work in MPPT or current control mode in both grid-connected and stand-alone operations. For larger DGs and energy storage units which are

dominant microgrid power sources, voltage control mode is implemented in operation modes to avoid control scheme transients. However, some modifications should be applied to the voltage control strategies in order to use them in grid-connected, stand-alone, and transient operation modes [29], [96]-[104]. For example, conventional droop method have been modified in [96], [97], [98] using the concept of virtual impedance, and combining PI controller with droop control, to be used in both grid-connected and stand-alone operation modes in the presence of DGs. As another example, conventional hierarchical control have been modified in [99] in order to improve weak disturbance rejection performance of conventional voltage and power sharing controllers to be used in both operation modes of microgrid.

In the transition from grid-connected to stand-alone operation mode, the control strategy, which can contain the synchronization unit, should provide a stable voltage with a fixed frequency in the microgrid. Moreover, it should share the power demand among DGs to continue supplying power to the loads within the microgrid. Transient power sharing among DGs or energy storage units are important for both groups of control strategies, and during stand-alone operation, the power electronic interfaced DGs initially picks up the majority of any load step, in some cases poor transient load sharing exist in the presence of DGs and conventional synchronous generators. In order to improve the transient power sharing, the coordination among DGs and conventional synchronous generators is necessary, and the DGs must allow the voltage and frequency to swing in the expense of increased voltage and frequency dip. For example, in [105] control strategy has been modified for the droop control in order to improve the transient load sharing by changing the droop slope during transient and restoring it to normal in steady state. The synchronverter concept proposed in [106], [107] and synchronous converter concept proposed in [108] are other methods that allow the power electronic interfaced DGs to follow the conventional synchronous generators principles and may help the transient load sharing.



## 2) Transition from stand-alone to grid-connected operation mode

In the transition from stand-alone to grid-connected operation mode, other than the control scheme (switch from voltage control to current/power control or through the uniformed control scheme as discussed earlier), an important task is that the microgrid voltage should be synchronized with the grid voltage before re-connection.

For synchronization of the microgrid to the main grid, there are mainly two types: a) passive synchronization, and b) active synchronization. For passive synchronization, the microgrid voltage and main grid voltage are monitored and the two grids are connected when they have the same phase angle. This method is based on the assumption that microgrid and the main grid have very close voltage magnitude and slightly different frequency (which is typically the case). The passive synchronization is the easiest and probably the most practical method so far. However, this method will lead to some transients upon re-connection of the two grids (due to not exactly matched voltage magnitude), and it does not guarantee a fast and controllable synchronization process.

On the other hand, active synchronization can achieve fast synchronization and seamless connection of the microgrid and the main grid, and has attracted considerable research efforts. However, since the microgrid consists of different RE-based and AE-based DGs, severely changing electrical loads, and storage devices, the synchronization of a microgrid is quite different in comparison to a single traditional machine. For active synchronization, coordination of multiple DGs and energy storages is required. In some cases, synchronization unit is embedded in the control strategies while in others, separate synchronization unit provides the synchronization signals in order to provide microgrid re-connection to the grid.

As discussed earlier in Section III, in stand-alone operation mode, two control strategies are possibly used; all DGs working on voltage control mode (for example, droop control or conventional voltage control mode applied to all DGs), or some DGs working on current control mode while the others working on voltage control mode (for example, master-slave control strategy or RE-based DGs working on MPPT while the controllable DGs working on voltage control mode). Depending on utilized control strategy, the active synchronization strategies can be classified into two groups; a) one/more DGs initiate the synchronization process and the other DGs follow them, and b) all DGs take part in the synchronization process simultaneously.

The first group of synchronization strategy is mainly used in the microgrids that some DGs are working on current control mode while the others are working on voltage control mode [102], [109], [110]. For example, in [109] active synchronization is applied for the controllable DGs to control the frequency and voltage of the microgrid while RE-based DGs are working on their MPP mode, and in [110], synchronization schemes utilized in master-slave control strategy are discussed where master DGs lead to the synchronization process.

The second group of synchronization strategy is mainly used in the microgrids that all DGs are working on the voltage control mode [29], [93], [96], [111]. For example, in [96] and [111], synchronization strategies are discussed in droop control methods where synchronizations are realized by droop characteristics adjustment, virtual impedance concept utilization of all DGs. After synchronization, the microgrid will be re-connected to the grid at the voltage zero crossing.

In both types of synchronization strategies, communication system is essential in order to communicate the system information among power sources. The communication systems utilized in the hybrid microgrids will be discussed in Section V.

## B. Power Management Strategies under Different Loading Conditions

In hybrid microgrids, loads and/or the grid conditions can have significant impacts on the performance of microgrid. As a result, robust current or voltage control is needed in these conditions. In the presence of nonlinear/unbalance loads, which result in unbalance voltage at PCC, various control strategies have been used. Detailed discussion will be provided in Section VI-C.

On the other hand, constant power loads (CPLs) which are mainly interfaced by active rectifiers to a AC grid or DC/DC converter to a DC grid, cause instability problems in the microgrids because of their negative impedance characteristics. These problems have been studied in different researches using small-signal method and large signal methods [112], [113], and various solutions have been proposed to ensure the system stability. These include oscillation compensation technique used to increase stability margin [114], active-damping techniques to overcome the negative impedance instability problem [115], nonlinear control of AC/DC converters [116], just to name a few. In addition, in some cases, CPLs are controlled to provide ancillary services to microgrids, such as harmonic minimization caused by power electronic non-linear load, shunt active filter, etc. [117].

In addition to constant power loads, which affect the microgrid stability, frequency and voltage dependant loads can influence the microgrid stability. It has been shown that in stand-alone operation, the frequency and voltage deviations are dependent on each other [118]. Therefore, microgrid unstable operation may be resulted as a consequence of load's voltage and frequency dependence [118]. For example, induction motors are frequency and voltage dependant loads in the microgrids, where conventional P/Q control strategies cannot guarantee the microgrid stability with these loads [119]. In the presence of frequency and voltage dependant loads, accurate loads models are essential for control system design in order to enhance the stability and transient performance [120]-[122].

## V. COMMUNICATION SYSTEMS IN HYBRID MICROGRIDS

In hybrid microgrids or in general in microgrids, the control and power management strategies can be classified into communication-based and communication-less strategies. In the communication-based strategies, the system information



generate hydrogen which is stored in the tanks. It is important to consider that the FC and the EL should not work at the same time for efficiency reasons. Therefore, selector is used in order to switch the control scheme between FC and EL based on its input power sign. Positive input power sign (low frequency components of  $P_{dispatched} > P_{WT}$ ) leads to FC power control mode while EL power control mode is activated in negative input power sign (low frequency component of  $P_{dispatched} < P_{WT}$ ). Here, the voltage and current controllers can be simple PI controllers. In this system, IFC works on DC link voltage control mode, and injects all DC-side generated power ( $P_{FC} + P_{SC} + P_{WT} - P_{EL}$ ) to AC bus/grid ( $P_{grid}^*$ ). Moreover, reactive power reference of IFC ( $Q_{grid}^*$ ) is determined considering the grid voltage conditions and control objectives.

Obviously this power balancing control scheme needs to have access to the output power of different sources, which makes it communications-based control strategy. The experimental verifications of this power balancing strategy of DC-coupled hybrid microgrid can be found in [59].

### B. Stand-alone Operation of AC-DC-Coupled Hybrid Microgrid

In AC-DC-coupled hybrid microgrids, good coordination between the DC and AC subsystems are necessary in order to control DC bus voltage, balance the power within DC bus and AC bus, and regulate AC bus voltage and frequency. Here, an example of droop control for both DC and AC buses voltage regulation is presented [6]. It is important to note that power sharing in both DC and AC buses is highly depend on the ILC control strategy (see Fig. 6).

#### 1) Droop control method

Droop control method can be applied for both DC bus and AC bus. In AC droop control method, AC bus voltage and frequency are controlled, and the demand power is shared among input power sources (respective to their power capacities). In this method, each DG-SE on AC bus accompany with its power converter and ILC are modeled as inverters connected to AC bus through coupling impedances. To emulate the behavior of synchronous generators, the  $P-f$  droop and  $Q-V$  droop characteristics are programmed to the converters control [29], [45], [46]. In order to make the sources share the demand power in proportion to their power ratings, the droop coefficients should be adjusted in inverse proportion to their rated power. The  $P-f$  droop and  $Q-V$  droop diagrams of two DG units are shown in Fig. 9(a) and Fig. 9(b). In this figure,  $P_1^*$ ,  $P_2^*$ ,  $Q_1^*$ ,  $Q_2^*$  are the reference active and reactive powers in the grid-connected mode (no-load operation), and  $P_{1,max}$ ,  $P_{2,max}$ ,  $Q_{1,max}$ ,  $Q_{2,max}$  are the maximum possible output real and reactive powers of two DGs. According to this figure, DGs produce their reference output active and reactive powers at the grid frequency and voltage ( $f^*$  and  $V^*$ ) by adjusting the droop slopes ( $m_1$  and  $m_2$ ) and ( $n_1$  and  $n_2$ ).

In addition to the above mention droop method (direct droop control method), in non-dispatchable DGs such as wind power and PV systems, inverse droop method is

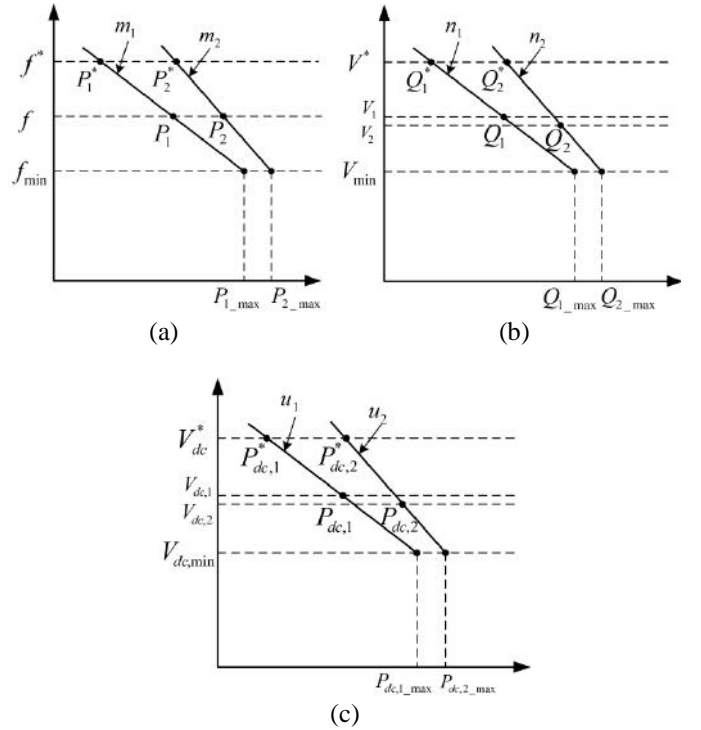


Fig. 9 Droop slopes for two DGs; (a)  $P-f$  droop in AC subsystem, (b)  $Q-V$  droop in AC subsystem, and (c)  $P-V$  droop in DC subsystem.

used [132], [133]. In this control strategy, the inputs of the droop controller block are the PCC voltage parameters (amplitude and frequency), and its outputs are the reference active and reactive powers. In other words, in inverse droop control,  $P-f$  and  $Q-V$  droop characteristics are used to change the active and reactive powers generation according to control frequency and voltage variations. In this strategy, DGs work on output power control mode to provide grid support functions. More discussion in this is provided later.

Compared to AC bus droop control, the DC bus droop control is simpler as only the active power and voltage magnitude droop ( $P-V$  droop) is relevant [62], [64]. Similarly, for proportional active power sharing to DGs power ratings, the droop coefficients should be adjusted in inverse proportion to DG's or SE's rated power [6]. Fig. 9(c) represents the  $P-V$  droop diagram of two DG units connected to DC bus. In this figure,  $V_{dc}^*$  is the maximum voltage of DC bus under no load condition,  $V_{dc,min}$  is the allowable minimum voltage of DC bus, and  $P_{dc,max1}$  and  $P_{dc,max2}$  are the maximum real power of DGs. With this droop control, different line impedances lead to unequal dc source terminal voltages ( $V_{dc,1}$  and  $V_{dc,2}$  in Fig. 9(c)), which cause error in active power sharing [6], [7]. This is similar to the effects of line impedance to the reactive power sharing in an AC system (see Fig. 9(b)) [40], [134].

#### 2) Interlinking converter control strategy

The ILC is responsible to link AC and DC subsystem to form AC-DC-coupled hybrid microgrid. Among various power management schemes (see Fig. 6), autonomous control scheme



is considered in this example [6], [7]. In this scheme, Per-Unit (P.U.) values of the DC subsystem voltage and AC subsystem frequency are measured, and their difference is used to adjust the power demand of the ILC for DC or AC subsystem support. Multiple ILCs could be used in parallel with enhanced capacity and reliability. In Fig. 10, the block diagram of AC-DC-coupled hybrid microgrid in stand-alone operation mode is shown, and the control scheme of one ILC (in  $\alpha\beta$  frame) is shown Fig. 11.

For proper power sharing among interlinking converters in order to control normalized DC subsystem voltage and AC subsystem frequency, different power controllers ( $K_P$ ) are used for each ILC, which provide the alternative droop control technique among ILCs. These controllers are designed based on maximum difference of DC voltage and AC frequency P.U. values ( $e$ ) in the microgrid and each ILC's power rating.

After determining the reference active and reactive powers, ILCs work on power control mode in order to regulate output active and reactive powers on their reference values, and regulates AC and DC buses voltages (see Fig. 11). Note that the reactive power control of ILCs can be realized with  $Q - V$  droop control, unity power factor control, etc. In this example, unity power factor control is considered as the focus is on real power exchange.

The experiments are conducted on a three-phase interlinking converter prototype, and the system is controlled by dSPACE 1103. In this test, the frequency range of  $59\text{Hz} < f < 61\text{Hz}$  is considered for AC subsystem, and voltage range of  $140\text{V} < V_{dc} < 160\text{V}$  is considered for DC subsystem. Moreover, the interlinking converter is rated at 375W, which can transfer a maximum of 80% rated capacity from underloaded to overloaded subsystem. In the control system, the normalization is done considering following expressions [6]:

$$f_{P.U.} = \frac{f - 0.5 \times (f_{max} + f_{min})}{0.5 \times (f_{max} - f_{min})}$$

$$V_{dc, P.U.} = \frac{V_{dc} - 0.5 \times (V_{dc,max} + V_{dc,min})}{0.5 \times (V_{dc,max} - V_{dc,min})}$$

In this test, two types of experiments are conducted; DC subsystem voltage variation and AC subsystem frequency variation. In the first test, DC subsystem voltage is varied from 150V to 160V and then from 160V to 155V while the AC subsystem frequency is fixed at 60Hz, and the ILC behavior is analyzed. The results are shown in Fig. 12, where it can be seen




Fig. 10 AC-DC-coupled hybrid microgrid in stand-alone operation mode with normalized droop method in both AC and DC subsystems and autonomous ILCs control.

that variation of  $V_{dc}$  from 150V (where the power transfer is zero in the AC subsystem frequency of 60Hz) to 160V will result in active power transferring from DC subsystem to AC subsystem, and the reduction of  $V_{dc}$  from 160V to 155V will reduce the injected power to AC subsystem as expected.

In the second test, the AC subsystem frequency is varied from 60Hz to 59Hz and from 59Hz to 59.5Hz while the DC subsystem voltage is set at 150V. As shown in Fig. 13, the active power is transferred from DC subsystem to AC subsystem to support the frequency reduction when AC subsystem frequency is varied from 60Hz to 59Hz. Moreover, increasing the AC subsystem frequency from 59Hz to 59.5Hz will reduce the transferred power from DC to AC subsystem. The results are shown in Fig. 13.

### C. Grid Support Control Examples

As discussed earlier, the AC bus connected DGs-SEs as well as the ILCs and IFCs can be used for supporting the grid. The main objective of the grid support is regulating the AC voltage by controlling active and reactive powers delivered to the AC bus. In addition to the above mention objectives, unbalance compensation, harmonic control, power factor correction, etc. can be considered as grid support objectives. Here two examples of the grid support control strategies are presented: the grid voltage (amplitude and frequency) support and the grid unbalanced voltage compensation.

#### 1) Grid voltage amplitude and frequency support

In this control strategy, the grid-supporting power converter can be controlled as a current source or voltage source [135]. In the current source operation, the grid-supporting power converter regulates the variations of voltage amplitude and frequency of microgrid and AC grid. The block diagram of this control strategy is shown in Fig. 14(a).




Fig. 11 Control block diagram of one ILC in stand-alone operation mode with normalized droop method in both AC and DC buses.




Fig. 12 Variation of DC subsystem voltage; (a) DC subsystem voltage 20V/div, (b) DC subsystem voltage P.U. values 1/div, and (c) interlinking converter output active power transferred to the AC subsystem 500W/div; (time: 10s/div).




Fig. 13 Variation of AC subsystem frequency; (a) AC subsystem frequency P.U. values 1/div, (b) AC subsystem frequency 20Hz/div, and (c) interlinking converter output active power transferred to the AC subsystem 500W/div; (time: 1s/div).

In this control strategy, the frequency variation is controlled by the active power while the reactive power controls the amplitude of voltage. The frequency and voltage controllers are proportional controllers ( $K_p$  and  $K_q$ ) for realizing the inverse  $P-f$  and  $Q-V$  droop control. Depend on the utilized reference frame ( $dq$  or  $\alpha\beta$ ), the reference currents are generated using reference active and reactive powers and PCC voltage amplitude. In this strategy, PI controllers with decoupling terms between  $d$  and  $q$  axis can be used as a current controller in  $dq$  reference frame while proportional current controllers are used in  $\alpha\beta$  reference frame.

In voltage source operation (Fig. 14(b)) where the power converter works as a controllable voltage source, a linking impedance will be necessary between the converter and grid, which can be a physical impedance or a virtual impedance [134], [135]. In this control scheme, the active and reactive power controllers are proportional controllers ( $k_p$  and  $k_q$ ) for realizing  $P-f$  and  $Q-V$  droop control. In this strategy, the output three-phase voltages at PCC are regulated on their reference values with closed-loop control system.

## 2) Grid unbalance voltage support

Unbalance voltage compensation can be used in grid-connected operation mode with unbalance loads or grid faults.

In this control, negative sequence current is generated to reduce negative sequence of voltage at PCC. The control block diagram for unbalance voltage compensation is shown in Fig. 15. The control is implemented in the stationary  $\alpha\beta$  frame to avoid multiple frame transformations for different sequence components control [136]. In this control scheme, the active power reference ( $P^*$ ) is provided by power management strategies or dc-link voltage regulator, and reactive power reference is provided by voltage support strategies, phase current limitation scheme, etc. [137].

In the control system, different sequence extractor can be used to extract voltage sequence components [138]-[140]. These positive and negative sequence voltages generate the reference currents of inverter as following [136]:

$$I_{\alpha}^* = P^* \left( \frac{k_1}{|V^+|^2} V_{\alpha}^+ + \frac{(1-k_1)}{|V^-|^2} V_{\alpha}^- \right) + Q^* \left( \frac{k_2}{|V^+|^2} V_{\beta}^+ + \frac{(1-k_2)}{|V^-|^2} V_{\beta}^- \right)$$

$$I_{\beta}^* = P^* \left( \frac{k_1}{|V^+|^2} V_{\beta}^+ + \frac{(1-k_1)}{|V^-|^2} V_{\beta}^- \right) - Q^* \left( \frac{k_2}{|V^+|^2} V_{\alpha}^+ + \frac{(1-k_2)}{|V^-|^2} V_{\alpha}^- \right)$$

where  $k_1$  and  $k_2$  provide flexible control of positive and negative sequences. By controlling these coefficients, in addition to unbalance voltage compensation, active power oscillation cancellation, reactive power oscillation cancellation, DG phase current limitation, etc. can be obtained [136].

As a case study, the above mentioned grid unbalance voltage support strategy (active power oscillation cancellation)




Fig. 14 Power converter control in grid voltage amplitude and frequency support: (a) as a current source, (b) as a voltage source.

is conducted. The experiments are conducted on a three-phase grid interfacing DG system prototype. In this test, the control system is switched between two operation modes. In the first operation mode, just positive sequence of active and reactive powers are injected to the grid ( $k_1 = 1$  and  $k_2 = 1$ ), and in second mode, cancellation of active power oscillation method is applied ( $k_1 = |v^+|^2 / (|v^+|^2 - |v^-|^2)$  and  $k_2 = |v^+|^2 / (|v^+|^2 + |v^-|^2)$ ) [136]. The negative sequence component of PCC voltage is shown in Fig. 16, where it can be seen that the control strategy decreases the negative sequence component of PCC voltage. The active power oscillations as plotted in Fig. 17 show that oscillations are zero with the above mentioned method.

## VII. DISCUSSIONS AND FUTURE TRENDS

Considering the increasing penetration of DC voltage based renewable energy sources, energy storage and DC loads, as well as the existing wide spread AC systems; hybrid AC/DC microgrids are inevitable parts of future power systems. So far in this paper, a thorough review and discussion of different hybrid microgrid structures, power management schemes under different operation and loading conditions, and implementation examples have been conducted. In this section, some discussions and recommendations about future trends of hybrid AC/DC microgrids are provided:

### A. Structures of Hybrid AC/DC Microgrids

Among different structures of hybrid AC/DC microgrids, AC-coupled hybrid microgrids have been the dominant structure up to now because of its simple structure and control schemes. However, with the increase of modern DC loads and the necessity of connecting more renewable energy sources and energy storage systems into the grid, AC-DC-coupled hybrid microgrids are the future trend of power system. AC-DC-coupled hybrid microgrids can reduce the number of power conversion process, which improves overall efficiency and reduces cost. However, in these systems, control schemes and power management strategies are the major concern and challenges. Since DGs and SEs are connected to both AC and DC bus, more coordination between the DC and AC subsystems are necessary. Future AC-DC-coupled microgrids will have several DC and AC buses in different voltage levels (and maybe frequencies if there is high frequency links). As a result, DC bus voltage control, power balancing within DC bus, AC bus and grid/load, and AC bus voltage and frequency

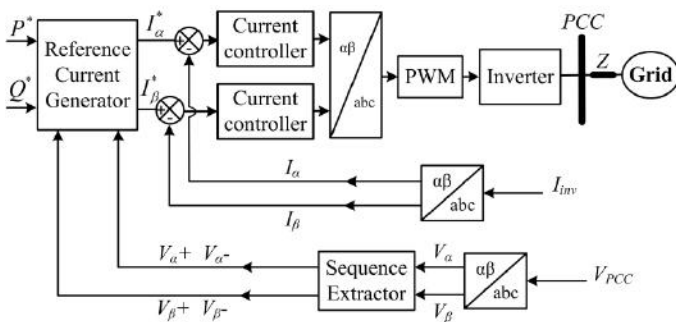


Fig. 15 Control block diagram for unbalance voltage compensation in grid-support control.




Fig. 16 Negative sequence of PCC voltage in positive sequence powers injection mode and cancellation of active power oscillation mode (time: 1s/div, voltage: 1V/div).




Fig. 17 Inverter output active power injected to the PCC in positive sequence powers injection mode and cancellation of active power oscillation mode (time: 2s/div, power: 50W/div).

control (if necessary) are the main power management challenges and objectives. Moreover, the operation of interlinking converters connecting different DC and AC buses in different voltage levels can be an interesting research topic in the future.

### B. Power Quality Issues

In future hybrid AC/DC microgrids, with more interfacing power electronics from the DGs, SEs and the loads, together with the increasing nonlinear loads, power quality will be an important topic. Currently, harmonics, unbalances, and voltage sag/swell have already caused concerns in today's power distribution system, and it may get worse in the near future. However, with the increasing utilization of DG/SE interfacing converters, they can be properly controlled to help address the power quality issues. This is a promising idea as most DGs, SEs, and interlinking or interfacing converters in the hybrid microgrids are not operating at full rating all the time (especially true when considering the intermittent nature of renewable energy sources). The available converter rating can be used in a smart way to help improve the power quality. Therefore, development of ancillary services such as flicker mitigation, unbalance voltage compensation, harmonic compensation, power factor correction, etc. can be a good research direction for future microgrid systems.



### C. Parallel Operation of ILCs and IFCs

Interfacing converters (IFCs) and interlinking converters (ILCs) are critical links between AC and DC bus in a hybrid microgrid system. Their control is the key for the power balance between DC and AC subsystems. Due to the requirement of higher ratings compared to other DG's or SE's interfaces, these IFCs and ILCs will typically have parallel converters operating together. Therefore, the parallel operation of these converters is an interesting topic for further research.

For the parallel converters, control strategies such as master-slave and instantaneous current sharing methods such as average current control and circular-chain control, can be used. In addition to the above mentioned methods which need communication, communication-less control strategy (such as droop control as discussed in the example in Section VI) can also be considered for controlling parallel converters, which may be important when the parallel IFCs and ILCs are not physically close as there might be multiple links between the DC and AC buses at various locations with higher reliability.

In addition, as discussed earlier, the IFCs and ILCs can be in power control mode, DC voltage control mode, or AC voltage control mode. However, it is not necessary for all parallel IFCs or ILCs to work in the same control mode together. For example, for a AC-DC-coupled microgrid, it is possible that some ILCs control the DC link voltage, some ILCs control the AC link voltage and some ILCs balance the power. This combination of control strategies requires further study and investigation.

Moreover, the performance of parallel IFCs or ILCs during the microgrid transition between grid-connected and stand-alone operation modes need to be considered in the future research.

### D. Communication Systems in Microgrids

Future microgrids will most likely consist of combination of various communication technologies that operate efficiently together. These technologies will be both wire-less and wire-line technologies, where using the appropriate technology for the right application is still an open problem. For instance, although PLC can be used for advanced metering infrastructures, some challenges such as reliability and performance should be considered. In the other hand, wire-less technique can provide a better alternative for long-range transmission because of its possibility of adopting cooperative communications or cognitive radio. However, the security concerns should be considered in the future communication systems. All in all, the communication systems play an important role in the future microgrids and need more investigations.

### E. Transient Power Management under Different Load /Grid Conditions

The power management and control strategies of hybrid microgrid should have a good performance under grid-connected, stand-alone, and during transition operation modes. Moreover, the transition between grid-connected and stand-

alone operating modes should be seamless and smooth. On the other hand, loads and/or the grid conditions can have significant impacts on the performance of microgrid. Although these challenges have been considered separately in different researches, considering the real hybrid microgrids, transient power management under different load/grid conditions need to be further studied in future researches.

### F. Economic Concerns

In general, economics is an important aspect of microgrids design and operation. Although microgrids may not be economical compared to traditional AC grids, in some regions with high electricity rate and demand charges, microgrids can be cost-effective. Moreover, as technology and industry mature, their cost will decrease which leads to more economical microgrids. Further, the grid support and ancillary functions of microgrid could potentially improve the cost-effectiveness of a microgrid system. After all, the economic issues need to be properly addressed before large scale penetration of microgrids can be the reality.

### G. New Semiconductor Technologies

Recently, emerging new semiconductor devices using silicon carbide and gallium nitride has improved the power electronic switches technology. Utilizing these materials in the power converters, higher switching frequency can be used which can improve the overall performance of hybrid microgrid. These device technologies are in their early stages of development which require more study in the future, but in applications that require better performance with no concern about cost, they are already being used. Moreover, improving the efficiency of renewable energy sources (for example, solar cells), and improving the durability and performance of energy storage devices as a critical component of microgrids requires further study and investigation. In addition, utilizing the electric vehicles (EV) as active elements to support grid services and guarantee supply continuity necessitate further research and consideration.

## VIII. CONCLUSIONS

In this paper, the topology and control schemes of hybrid AC/DC microgrids are reviewed. Various structures of hybrid AC/DC microgrids (AC-coupled, DC-coupled, and AC-DC-coupled) are discussed, and real world examples of different types of hybrid microgrid are presented. In the operation of hybrid AC/DC microgrids, the control schemes and power management strategies are one of the most important considerations. Therefore, a thorough review and discussion of different control schemes and power management strategies of different types of microgrids under different operation and loading conditions are conducted in this paper. Implementation examples of some representative control schemes are presented to better illustrate the power management strategies. At last, discussion and recommendations about the future research directions on AC/DC hybrid microgrids and power management strategies are provided.

## REFERENCES

- [1] M. H. Nehrir, C. Wang, K. Strunz, H. Aki, R. Ramakumar, J. Bing, Z. Miao, and Z. Salameh, "A Review of Hybrid Renewable/Alternative Energy Systems for Electric Power Generation: Configurations, Control, and Applications", *IEEE Trans. Sustain. Energy*, vol. 2, no. 4, pp. 392–403, Oct. 2011.
- [2] D. Rastler, "Electricity Energy Storage Technology Options, A white Paper primer on Applications, Costs, and Benefits," *EPRI Publication* 1020676, Dec. 2010.
- [3] K. Strunz and H. Louie, "Cache Energy Control for Storage: Power System Integration and Education Based on Analogies Derived From Computer Engineering," *IEEE Trans. Power System*, vol. 24, no. 1, pp. 12–20, Feb. 2009.
- [4] A. Mohamed, V. Salehi, and O. Mohammed, "Real-Time Energy Management Algorithm for Mitigation of Pulse Loads in Hybrid Microgrids," *IEEE Trans. Smart Grid*, vol. 3, no. 4, pp. 1911–1922, Dec. 2012.
- [5] K. Kurohane, T. Senjyu, A. Yona, N. Urasaki, T. Goya, and T. Funabashi, "A hybrid smart AC/DC power system," *IEEE Trans. Smart Grid*, vol. 1, no. 2, pp. 199–204, 2010.
- [6] P. Ch. Loh, D. Li, Y. K. Chai, and F. Blaabjerg, "Autonomous Operation of Hybrid Microgrid With AC and DC Subgrids", *IEEE Trans. Power Electron.* vol. 28, no. 5, pp. 2214–2223, May. 2013.
- [7] P. Ch. Loh, D. Li, Y. K. Chai, and F. Blaabjerg, "Autonomous Control of Interlinking Converter With Energy Storage in Hybrid AC–DC Microgrid", *IEEE Trans. Ind. App.*, vol. 49, no. 3, pp. 1374–1383, May 2013.
- [8] S. A. Pourmousavi, M. H. Nehrir, Ch. M. Colson, and C. Wang, "Real-Time Energy Management of a Stand-Alone Hybrid Wind-Microturbine Energy System Using Particle Swarm Optimization," *IEEE Trans. Sustainable Energy*, vol. 1, no. 3, pp. 193–202, Oct. 2010.
- [9] H. Kanchev, D. Lu, F. Colas, V. Lazarov, and B. Francois, "Energy Management and Operational Planning of a Microgrid With a PV-Based Active Generator for Smart Grid Applications," *IEEE Trans. Ind. Electron.*, vol. 58, no. 10, pp. 4583–4593, Oct. 2011.
- [10] B. Kroposki, R. Lasseter, T. Ise, S. Morozumi, S. Papathanassiou, and N. Hatzargyriou, "A look at microgrid technologies and testing projects from around the world," *IEEE Power Energy Mag.*, vol. 6, no. 3, pp. 40–53, May/June. 2008.
- [11] N. W. A. Lidula and A. D. Rajapakse, "Microgrids research: a review of experimental microgrids and test systems," *Renewable and Sustainable Energy Reviews*, vol. 15, no. 1, pp. 186–202, 2011.
- [12] S. Morozumi, H. Nakama, and N. Inoue "Demonstration projects for grid-connection issues in Japan" *Elektrotechnik & Informationstechnik* 2008;125(12):426–31.
- [13] T. Loix, KU. Leuven, The first micro grid in the Netherlands: Bronsbergen. Available online on February 2009. [Online]. Available: [http://www.leonardo-energy.org/webfm\\_send/493](http://www.leonardo-energy.org/webfm_send/493).
- [14] I. Mitra, T. Degner, M. Braun, "Distributed generation and microgrids for small island electrification in developing countries: a review," *SESI Journal*, vol. 18, no. 1, pp. 6–20, Jan. 2008.
- [15] I. Araki, M. Tatsunokuchi, H. Nakahara, T. Tomita, "Bifacial PV system in Aichi Airport-site demonstrative research plant for new energy power generation," *Elsevier Journal, Solar Energy Materials and Solar Cells*, vol. 93, no. 6, pp. 911–916, Jun. 2009.
- [16] T. Haimin, J. L. Duarte, and M. Hendrix, "Multiport converters for hybrid power sources," in *Proc. IEEE Power Electron. Specialists Conf., PESC 2008*, pp. 3412 – 3418.
- [17] H. Tao, J. L. Duarte, and M. A. M. Hendrix, "Three-port triple-half-bridge bidirectional converter with zero-voltage switching," *IEEE Trans. Power Electron.*, vol. 23, no. 2, pp. 782–792, Mar. 2008.
- [18] M. Sarhangzadeh, H. Hosseini, M. Sharifian, and B. Gharehpetian, "Multiinput direct DC–AC converter with high-frequency link for clean power-generation systems", *IEEE Trans. Power Electron.*, vol. 26, no. 6, pp. 1777–1789, Jun. 2011.
- [19] Z. Qian, O. Abdel-Rahman, and I. Batarseh, "An integrated four-port DC/DC converter for renewable energy applications", *IEEE Trans. Power Electron.*, vol. 25, no. 7, pp. 1877–1887, Jul. 2010.
- [20] Zh. Qian, O. A. Rahman, H. A. Atrash, and I. Batarseh, "Modeling and control of three-port DC/DC converter interface for satellite applications," *IEEE Trans. Power Electron.*, vol. 25, no. 3, pp. 637–649, Mar. 2010.
- [21] Cesi Ricerca DER Test Facility (DER-TF), Italy, [Online]. Available: <http://www.der-ri.net/index.php?id=10>.
- [22] Hawaii Natural Energy Institute, Hawaii Hydrogen Power Park, [Online]. Available: <http://www.hnei.hawaii.edu/research/hawaii-hydrogen-power-park>
- [23] Y. Chen, Y. Liu, and S. Hung, "Multi-input inverter for grid-connected hybrid PV/Wind power system", *IEEE Trans. Power Electron.*, vol. 22, no. 3, pp. 1070–1077, May. 2007.
- [24] W. Jiang, and B. Fahimi, "Multiport power electronic interface: concept, modeling, and design", *IEEE Trans. Power Electron.*, vol. 26, no. 7, pp. 1890–1900, Jul. 2011.
- [25] F. Nejbatkhan, S. Danyali, H. Hosseini, and M. Sabahi, "Modeling and control of a new three-input DC-DC boost converter for hybrid PV/FC/Battery power system", *IEEE Trans. Power Electron.*, vol. 27, no. 5, pp. 2309–2324, May. 2012.
- [26] D. Van Hertem, M. Ghandhari, M. Delimar, "Technical limitations towards a SuperGrid-A European prospective," in *Proc. 2010 IEEE Energy Conference and Exhibition (Energy Con)*, pp. 302–309.
- [27] S. Gordon, "Supergrid to the rescue," *Power Engineering*, vol.20, no.5, pp. 30–33, Oct.–Nov. 2006.
- [28] P. Fairley, "Germany jump-starts the supergrid," *Spectrum, IEEE*, vol.50, no.5, pp. 36–41, May 2013.
- [29] Y. W. Li, D. M. Vilathgamuwa, and P. C. Loh, "Design, Analysis and Real-Time Testing of Controllers for Multi-Bus Microgrid System," *IEEE Trans. Power Electron.*, vol. 19, pp. 1195–1204, Sep. 2004.
- [30] J. M. Guerrero, J. C. Vasquez, J. Matas, L. G. de Vicuña, and M. Castilla, "Hierarchical Control of Droop-Controlled AC and DC Microgrids—A General Approach Toward Standardization", *IEEE Trans. Ind. Electron.*, vol. 58, no. 1, pp. 158–172, Jan. 2011.
- [31] J. Y. Kim, J. H. Jeon, S. K. Kim, Ch. Cho, J. H. Park, H. M. Kim, and K. Y. Nam, "Cooperative Control Strategy of Energy Storage System and Microsources for Stabilizing the Microgrid during Islanded Operation", *IEEE Trans. Power Electron.*, vol. 25, no. 12, pp. 3037–3048, Dec. 2010.

- [32] K. T. Tan, P. L. So, Y. C. Chu, and M. Z. Q. Chen, "Coordinated Control and Energy Management of Distributed Generation Inverters in a Microgrid", *IEEE Trans. Power Delivery*, vol. 28, no. 2, pp. 704–713, Apr. 2013.
- [33] K. T. Tan, X. Y. Peng, P. L. So, Y. C. Chu, and M. Z. Q. Chen, "Centralized Control for Parallel Operation of Distributed Generation Inverters in Microgrids", *IEEE Trans. Smart Grid*, vol. 3, no. 4, pp. 1977–1987, Dec. 2012.
- [34] C. T. Rodríguez, D. V. de la Fuente, G. Garcerá, E. Figueres, and J. A. G. Moreno, "Reconfigurable Control Scheme for a PV Microinverter Working in Both Grid-Connected and Island Modes", *IEEE Trans. Ind. Electron.*, vol. 60, no. 4, pp. 1582–1595, Apr. 2013.
- [35] Sh. Jiang, W. Wang, H. Jin, and D. Xu, "Power Management Strategy for Microgrid with Energy Storage System," in *Proc. 2011 IEEE IECON- 37th Annual Industrial Electronics Society Conf.*, pp. 1524–1529.
- [36] Ch. K. Sao, and P. W. Lehn, "Control and Power Management of Converter Fed Microgrids", *IEEE Trans. Power System*, vol. 23, no. 3, pp. 1088–1098, Aug. 2008.
- [37] J. C. Vasquez, R. A. Mastromauro, J. M. Guerrero, and M. Liserre, "Voltage Support Provided by a Droop-Controlled Multifunctional Inverter", *IEEE Trans. Ind. Electron.*, vol. 56, no. 11, pp. 4510–4519, Nov. 2009.
- [38] F. Katiraei, and M. R. Iravani, "Power Management Strategies for a Microgrid with Multiple Distributed Generation Units," *IEEE Trans. Power System*, vol. 21, no. 4, pp. 1821–1831, Nov. 2006.
- [39] J. H. Jeon, J. Y. Kim, S. K. Kim, and J. M. Kim, "Unified Compensation Control of a Hybrid Energy Storage System for Enhancing Power quality and Operation Efficiency in a Diesel and Wind-Turbine Based Stand-alone Microgrid," in *Proc. 2012 IEEE PEDG- 3rd International Symposium on Power Electronics for Distributed Generation Systems Conf.*, pp. 264–270.
- [40] J. He, and Y. W. Li, "An Enhanced Microgrid Load Demand Sharing Strategy," *IEEE Trans. Power Electron.*, vol. 27, no. 9, pp. 3984–3995, Sep. 2012.
- [41] Y. Li, and Y. W. Li, "Power Management of Inverter Interfaced Autonomous Microgrid Based on Virtual Frequency-Voltage Frame," *IEEE Trans. Smart Grid.*, vol. 2, no. 1, pp. 30–41, Mar. 2011.
- [42] Y. Chung, W. Liu, D. A. Cartes, E. G. Collins, and S. Moon, "Control Methods of Inverter-Interfaced Distributed Generators in a Microgrid System," *IEEE Trans. Industry App.*, vol. 46, no. 3, pp. 1078–1089, May. 2010.
- [43] E. Barklund, N. Pogaku, M. Prodanovic, C. H. Aramburo, and T. C. Green, "Energy Management in Autonomous Microgrid Using Stability-Constrained Droop Control of Inverters," *IEEE Trans. Power Electron.*, vol. 23, no. 5, pp. 2346–2352, Sep. 2008.
- [44] K. D. Brabandere, B. Bolsens, J. V. D. Keybus, A. Woyte, J. Driesen, and R. Belmans, "A voltage and frequency droop control method for parallel inverters," *IEEE Trans. Power Electron.*, vol. 22, no. 4, pp. 1107–1115, Jul. 2007.
- [45] M.C. Chandorkar, D. M. Divan, and R. Adapa, "Control of parallel connected inverters in standalone AC supply systems," *IEEE Trans. Ind. Applicat.*, Vol. 29, pp. 136–143, Jan/Feb 1993.
- [46] J. M. Guerrero, L. G. de Vicuña, J. Matas, M. Castilla, and J. Miret, "A Wireless Controller to Enhance Dynamic Performance of Parallel Inverters in Distributed Generation Systems", *IEEE Trans. Power Electron.*, vol. 19, no. 5, pp. 1205–1214, Sep. 2004.
- [47] B. Belvedere, M. Bianchi, A. Borghetti, C. A. Nucci, M. Paolone, and A. Peretto, "A Microcontroller-Based Power Management System for Standalone Microgrids With Hybrid Power Supply", *IEEE Trans. Sustainable Energy*, vol. 3, no. 3, pp. 422–431, Jul. 2012.
- [48] C. Wang and M. H. Nehrir, "Power management of a stand-alone wind/photovoltaic/fuel-cell energy system," *IEEE Trans. Energy Convers.*, vol. 23, no. 3, pp. 957–967, Sep. 2008.
- [49] J. F. Chen and C. L. Chu, "Combination voltage-controlled and current controlled PWM inverters for UPS parallel operation," *IEEE Trans. Power Electron.*, vol. 10, no. 5, pp. 547–558, Sep. 1995.
- [50] Y. Pei, G. Jiang, X. Yang, and Z. Wang, "Auto-master-slave control technique of parallel inverters in distributed AC power systems and UPS," in *Proc. Power Electron. Spec. Conf.*, Jun. 2004, vol. 3, pp. 2050–2053.
- [51] H. Broeck and U. Boeke, "A simple method for parallel operation of inverters," in *Proc. IEEE-INTELEC*, 1998, pp. 143–150.
- [52] T. F. Wu, Y. K. Chen, and Y. H. Huang, "3C strategy for inverters in parallel operation achieving an equal current distribution," *IEEE Trans. Ind. Electron.*, vol. 47, no. 2, pp. 273–281, Apr. 2000.
- [53] X. Sun, Y. S. Lee, and D. H. Xu, "Modeling, analysis, and implementation of parallel multi-inverter systems with instantaneous average current-sharing scheme," *IEEE Trans. Power Electron.*, vol. 18, no. 3, pp. 844–856, May 2003.
- [54] Y. K. Chen, Y. E. Wu, T. F. Wu, and C. P. Ku, "ACSS for paralleled multiinverter systems with DSP-based robust controls," *IEEE Trans. Aerosp. Electron. Syst.*, vol. 39, no. 3, pp. 1002–1015, Jul. 2003.
- [55] F. Bouhafs, M. Mackay, M. Merabti, "Links to the Future: Communication Requirements and Challenges in the Smart Grid," *IEEE Power and Energy Magazine*, vol. 10, no.1, pp.24–32, Jan.-Feb. 2012.
- [56] F. Blaabjerg, R. Teodorescu, M. Liserre and A. V. Timbus, "Overview of Control and Grid Synchronization for Distributed Power Generation Systems," *IEEE Trans. Ind. Electron.*, vol. 53, pp. 1398–1409, Oct. 2006.
- [57] A. Yazdani, and R. Iravani, "Voltage-sourced converter in power systems: Modelling, control, and application", *WILEY, IEEE PRESS*, 2010.
- [58] J. M. Carrasco, L. G. Franquelo, J. T. Bialasiewicz, E. Galvan, R. C. P. Guisado, M. A. M. Prats, J. I. Leon, and N. Moreno-Alfonso "Power-Electronic Systems for the Grid Integration of Renewable Energy Sources: A Survey," *IEEE Trans. Power Electron.*, vol. 53, pp. 1002–1016, Aug. 2006.
- [59] T. Zhou and B. François, "Energy Management and Power Control of a Hybrid Active Wind Generator for Distributed Power Generation and Grid Integration", *IEEE Trans. Ind. Electron.*, vol. 58, no. 1, pp. 95–104, Jan. 2011.
- [60] B. Wang, M. Sechilariu, and F. Locment, "Intelligent DC Microgrid with Smart Grid Communications: Control Strategy Consideration and Design", *IEEE Trans. Smart Grid.*, vol. 3, no. 4, pp. 2148–2156, Dec. 2012.
- [61] L. N. Khanh, J. J. Seo, Y. S. Kim, and D. J. Won, "Power-Management Strategies for a Grid-Connected PV-FC Hybrid



- System", *IEEE Trans. Power Delivery*, vol. 25, no. 3, pp. 1874–1882, Jul. 2010.
- [62] Y. Ito, Z. Yang, and H. Akagi, "DC micro-grid based distribution power generation system," in *Proc. IEEE Int. Power Electron. Motion Control Conf.*, Aug. 2004, vol. 3, pp. 1740–1745.
- [63] Z. Li, W. Tianjin, Wu, X. Yan, S. Kai, and J. M. Gurrero, "Power control of DC microgrid using DC bus signaling," *Twenty-Sixth Annual IEEE Applied Power Electronics Conf. and Exposition, APEC*, pp.1926-1932, Mar. 2011.
- [64] D. Chen and L. Xu, "Autonomous DC Voltage Control of a DC Microgrid With Multiple Slack Terminals," *IEEE Trans. Power Sys.*, vol. 27, no. 4, pp. 1897-1905, Nov. 2012.
- [65] H. Fakham, D. Lu, and B. Francois, "Power Control Design of a Battery Charger in a Hybrid Active PV Generator for Load-Following Applications", *IEEE Trans. Ind. Electron.* vol. 58, no. 1, pp. 85–94, Jan. 2011.
- [66] A. Hajizadeh, and M. A. Golkar, "Fuzzy neural control of a hybrid fuel cell/battery distributed power generation system", *IET Renew. Power Gener.*, vol. 3, no. 4, pp. 402–414, 2009.
- [67] N. Gyawali, Y. Ohsawa, and O. Yamamoto, "Power management of double-fed induction generator-based wind power system with integrated smart energy storage having superconducting magnetic energy storage/fuel-cell/electrolyser", *IET Renew. Power Gener.*, vol. 5, no. 6, pp. 407–421, 2011.
- [68] H. Kakigano, Y. Miura, and T. Ise, "Distribution Voltage Control for DC Microgrids Using Fuzzy Control and Gain-Scheduling Technique", *IEEE Trans. Power Electron.*, vol. 28, no. 5, pp. 2246–2258, May. 2013.
- [69] D. V. de la Fuente, C. L. T. Rodríguez, G. Garcerá, E. Figueres, and R. O. González, "Photovoltaic Power System With Battery Backup With Grid-Connection and Islanded Operation Capabilities", *IEEE Trans. Ind. Electron.*, vol. 60, no. 4, pp. 1571–1581, Apr. 2013.
- [70] L. Xu, and D. Chen, "Control and Operation of a DC Microgrid With Variable Generation and Energy Storage", *IEEE Trans. Power Delivery*, vol. 26, no. 4, pp. 2513–2522, Oct. 2011.
- [71] N. Pogaku, M. Prodanovic, and T. C. Green, "Modeling, Analysis and Testing of Autonomous Operation of An Inverter-Based Microgrid," *IEEE Trans. Power Electron.*, vol. 22, pp. 613-625, Mar. 2007.
- [72] H. Yoo, S. K. Sul, Y. Park, and J. Jeong, "System Integration and Power-Flow Management for a Series Hybrid Electric Vehicle Using Supercapacitors and Batteries", *IEEE Trans. Ind. Application*, vol. 44, no. 1, pp. 108–115, Jan/Feb. 2008.
- [73] A. Tani, M. B. Camara, and B. Dakyo, "Energy Management Based on Frequency Approach for Hybrid Electric Vehicle Applications: Fuel-Cell/Lithium-Battery and Ultracapacitors," *IEEE Trans. Vehicular Technology*, vol. 61, no. 8, pp. 3375–3386, Oct. 2012.
- [74] M. B. Camara, B. Dakyo, and H. Gualous, "Polynomial Control Method of DC/DC Converters for DC-Bus Voltage and Currents Management—Battery and Supercapacitors," *IEEE Trans. Power Electron.*, vol. 27, no. 3, pp. 1455–1467, Mar. 2012.
- [75] P. Garcia, L. M. Fernandez, C. A. Garcia, and F. Jurado, "Energy Management System of Fuel-Cell-Battery Hybrid Tramway," *IEEE Trans. Ind. Electron.*, vol. 57, no. 12, pp. 4013–4024, Dec. 2010.
- [76] Ph. Thounthong, S. Pierfederici, J. Ph. Martin, M. Hinaje, and B. Davat, "Modeling and Control of Fuel Cell/Supercapacitor Hybrid Source Based on Differential Flatness Control," *IEEE Trans. Vehicular Technology.*, vol. 59, no. 6, pp. 2700–2711, Jul. 2010.
- [77] A. Ghazanfari, M. Hamzeh, H. Mokhtari, and H. Karimi, "Active Power Management of Multihybrid Fuel Cell/Supercapacitor Power Conversion System in a Medium Voltage Microgrid," *IEEE Trans. Smart Grid*, vol. 3, no. 4, pp. 1903–1911, Dec. 2012.
- [78] Ph. Thounthong, S. Pierfederici, and B. Davat, "Analysis of Differential Flatness-Based Control for a Fuel Cell Hybrid Power Source," *IEEE Trans. Energy Conv.*, vol. 25, no. 3, pp. 909–920, Sep. 2010.
- [79] I. Aharon and A. Kuperman, "Topological Overview of Powertrains for Battery-Powered Vehicles With Range Extenders", *IEEE Trans. Power Electron.*, vol. 26, no. 3, pp. 868–876, Mar. 2011.
- [80] J. Moreno, M. E. Ortúzar, and J. W. Dixon, "Energy-Management System for a Hybrid Electric Vehicle, Using Ultracapacitors and Neural Networks," *IEEE Trans. Ind. Electron.*, vol. 53, no. 2, pp. 614–623, Apr. 2006.
- [81] M. B. Camara, H. Gualous, F. Gustin, and A. Berthon, "Design and New Control of DC/DC Converters to Share Energy Between Supercapacitors and Batteries in Hybrid Vehicles," *IEEE Trans. Vehicular Technology*, vol. 57, no. 5, pp. 2721–2735, Sep. 2008.
- [82] M. B. Camara, H. Gualous, F. Gustin, A. Berthon, and B. Dakyo, "DC/DC Converter Design for Supercapacitor and Battery Power Management in Hybrid Vehicle Applications—Polynomial Control Strategy," *IEEE Trans. Ind. Electron.*, vol. 57, no. 2, pp. 587–597, Feb. 2010.
- [83] T. Azib, O. Bethoux, Gh. Remy, C. Marchand, and E. Berthelot, "An Innovative Control Strategy of a Single Converter for Hybrid Fuel Cell/Supercapacitor Power Source," *IEEE Trans. Ind. Electron*, vol. 57, no. 12, pp. 4024-4031, Dec. 2010.
- [84] A. Ravey, B. Blunier, and A. Miraoui, "Control Strategies for Fuel-Cell-Based Hybrid Electric Vehicles: From Offline to Online and Experimental Results," *IEEE Trans. Vehicular Technology*, vol. 61, no. 6, pp. 2452-2458, Jul. 2012.
- [85] H. Louie, and K. Strunz, "Superconducting Magnetic Energy Storage (SMES) for Energy Cache Control in Modular Distributed Hydrogen-Electric Energy Systems", *IEEE Trans. Applied Superconductivity*, vol. 17, no. 2, pp. 2361–2364, Jun. 2007.
- [86] X. Liu, P. Wang, and P. Ch. Loh, "A Hybrid AC/DC Microgrid and Its Coordination Control," *IEEE Trans. Smart Grid*, vol. 2, no. 2, pp. 278–286, Jul. 2011.
- [87] Zh. Jiang, X. Yu, "Hybrid DC- and AC-Linked Microgrids: Towards Integration of Distributed Energy Resources," *IEEE Energy 2030 Conf.*, pp.1-8, Nov. 2008.
- [88] H. Zhou, T. Bhattacharya, D. Tran, T. S. T. Siew, and A. M. Khambadkone, "Composite Energy Storage System Involving Battery and Ultracapacitor With Dynamic Energy Management in Microgrid Applications," *IEEE Trans. Power Electron.*, vol. 26, no. 3, pp. 923–931, Mar. 2011.
- [89] W. Rong-Jong, L. Chih-Ying, H. Yu-Chih, and Ch. Yung-Ruei, "Design of High-Performance Stand-Alone and Grid-Connected Inverter for Distributed Generation Applications," *IEEE Trans. Ind. Electron.*, vol. 60, no. 4, pp. 1542–1555, Apr. 2013.

- [90] Z. Yao, L. Xiao, and Y. Yan, "Seamless Transfer of Single-Phase Grid-Interactive Inverters Between Grid-Connected and Stand-Alone Modes," *IEEE Trans. Power Electron.*, vol. 25, no. 6, pp. 1597–1603, Jun. 2010.
- [91] IJ. Balaguer, L. Qin, Y. Shuitao, U. Supatti, and P. Fang Zheng, "Control for Grid-Connected and Intentional Islanding Operations of Distributed Power Generation," *IEEE Trans. Ind. Electron.*, vol. 58, no. 1, pp. 147–157, Jan. 2011.
- [92] H. Karimi, H. Nikkhajoei, and R. Iravani, "Control of an Electronically-Coupled Distributed Resource Unit Subsequent to an Islanding Event," *IEEE Trans. Power Del.*, vol. 23, no. 1, pp. 493–501, Jan. 2008.
- [93] M. Karimi-Ghartemani, "Universal Integrated Synchronization and Control for Single-Phase DC/AC Converters," *IEEE Trans. Power Electron.*, vol. 30, no. 3, pp. 1544–1557, Mar. 2015.
- [94] G. Hernandez-Gonzalez and R. Iravani, "Current Injection for Active Islanding Detection of Electronically-Interfaced Distributed Resources," *IEEE Trans. Power Del.*, vol. 21, no. 3, pp. 1698–1705, Jul. 2006.
- [95] L. A. C. Lopes and Y. Z. Zhang, "Islanding Detection Assessment of Multiinverter Systems with Active Frequency Drifting Methods," *IEEE Trans. Power Del.*, vol. 23, no. 1, pp. 480–486, Jan. 2008.
- [96] J. Kim, J. M. Guerrero, P. Rodriguez, R. Teodorescu, and K. Nam, "Mode Adaptive Droop Control With Virtual Output Impedances for an Inverter-Based Flexible AC Microgrid," *IEEE Trans. Ind. Electron.*, vol. 26, no. 3, pp. 689–702, Mar. 2011.
- [97] J. Matas, M. Castilla, L. G. Vicuna, J. Miret, and J. C. Vasquez, "Virtual Impedance Loop for Droop-Controlled Single-Phase Parallel Inverters Using a Second-Order General-Integrator Scheme," *IEEE Trans. Power Electron.*, vol. 25, no. 12, pp. 2993–3003, Dec. 2010.
- [98] J. M. Guerrero, J. C. Vasquez, J. Matas, M. Castilla, and L. G. de Vicuna, "Control Strategy for Flexible Microgrid Based on Parallel Line-Interactive UPS Systems," *IEEE Trans. Ind. Electron.*, vol. 56, no. 3, pp. 726–736, Mar. 2009.
- [99] Y. A.-R. I. Mohamed and A. Radwan, "Hierarchical Control System for Robust Micro-Grid Operation and Seamless Mode-Transfer in Active Distribution Systems," *IEEE Trans. Smart Grid*, vol. 2, no. 2, pp. 352–362, Jun. 2011.
- [100] J. He, and Y. W. Li, "Hybrid Voltage and Current Control Approach for DG-Grid Interfacing Converters With LCL filters," *IEEE Trans. Ind. Electron.*, vol. 60, no. 5, pp. 1797–1800, May 2013.
- [101] J. He, Y. Li, J. Guerrero, F. Blaabjerg, and J. Vasquez, "An Islanding Microgrid Power Sharing Approach using Enhanced Virtual Impedance Control Scheme," *IEEE Trans. Power Electron.*, vol. 28, no. 11, pp. 5272–5282, 2013.
- [102] T. L. Vandoorn, B. Meersman, J. D. M. De Kooning, and L. Vandevelde, "Transition from Islanded to Grid-Connected Mode of Microgrids with Voltage-Based Droop Control," *IEEE Trans. Power Sys.*, vol. 28, no. 3, pp. 2545–2553, Aug. 2013.
- [103] F. Gao and R. Iravani, "A Control Strategy for a Distributed Generation Unit in Grid-Connected and Autonomous Modes of Operation," *IEEE Trans. Power Del.*, vol. 23, no. 2, pp. 850–859, Apr. 2008.
- [104] H. Kim, T. Yu, and S. Choi, "Indirect Current Control Algorithm for Utility Interactive Inverters in Distributed Generation Systems," *IEEE Trans. Power Electron.*, vol. 23, no. 3, pp. 1342–1347, May 2008.
- [105] A. Paquette, and D. Divan, "Transient Droop for Improved Transient Load Sharing in Microgrids," in *Proc. IEEE Energy Conversion Congress and Exposition (ECCE) Conf.*, Sep. 2014, pp. 84–91.
- [106] Q.-C. Zhong and G. Weiss, "Synchronverters: Inverters that Mimic Synchronous Generators," *IEEE Trans. Ind. Electron.*, vol. 58, no. 4, pp. 1259–1267, Apr. 2011.
- [107] Q.-C. Zhong, P.-L. Nguyen, Z. Ma, and W. Sheng, "Self-Synchronised Synchronverters: Inverters without a Dedicated Synchronization Unit," *IEEE Trans. Power Electron.*, vol. 29, no. 2, pp. 617–630, Feb. 2014.
- [108] M. Ashabani and Y. A.-r. I. Mohamed, "New Family of Microgrid Control and Management Strategies in Smart Distribution Grids Analysis, Comparison and Testing," *IEEE Trans. Power Sys.*, vol. 29, no. 5, pp. 2257–2269, Sep. 2014.
- [109] Ch. Cho, J. H. Jeon, J. Y. Kim, S. Kwon, K. Park, and S. Kim, "Active Synchronizing Control of a Microgrid," *IEEE Trans. Power Electron.*, vol. 26, no. 12, pp. 3707–3720, Dec. 2011.
- [110] H. Xu, X. Zhang, F. Liu, D. Zhu, R. Shi, H. Ni, and W. Cao, "Synchronization Strategy of Microgrid from Islanded to Grid-Connected Mode Seamless Transfer," in *Proc. IEEE Region 10 Conf.*, TENCON, Oct. 2013, vol. 22, pp. 1–4.
- [111] Y. Jia, D. Liu, and J. Liu, "A Novel Seamless Transfer Method for a Microgrid Based on Droop Characteristic Adjustment," in *Proc. IEEE Power Electronics and Motion Control (IPEMC) Conf.*, Jun. 2012, vol. 1, pp. 362–367.
- [112] D. Marx, P. Magne, B. Nahid-Mobarakkeh, S. Pierfederici, and B. Davat, "Large Signal Stability Analysis Tools in DC Power Systems with Constant Power Loads and Variable Power Loads—A Review," *IEEE Trans. Power Electron.*, vol. 27, no. 4, pp. 1773–1787, Apr. 2012.
- [113] W. Du, J. Zhang, Y. Zhang, and Z. Qian, "Stability Criterion for Cascaded System with Constant Power Load," *IEEE Trans. Power Electron.*, vol. 28, no. 4, pp. 1843–1851, Apr. 2013.
- [114] P. Liutanakul, A. B. Awan, S. Pierfederici, B. Nahid-Mobarakkeh, and F. Meibody-Tabar, "Linear Stabilization of a DC Bus Supplying a Constant Power Load: A General Design Approach," *IEEE Trans. Power Electron.*, vol. 25, no. 2, pp. 475–488, Feb. 2010.
- [115] A. M. Rahimi, A. Emadi, "Active Damping in DC/DC Power Electronic Converters: A Novel Method to Overcome the Problems of Constant Power Loads," *IEEE Trans. Ind. Electron.*, vol. 56, no. 5, pp. 1428–1439, Apr. 2009.
- [116] E. Lenz, and D. J. Pagano, "Nonlinear Control of a Three-Phase Power Converter with Constant Power Load in a Microgrid," *IEEE Power Electronics Conf. (COBEP)*, vol. 27, Oct. 2013, pp. 368–373.
- [117] N. Jelani, and M. Molinas, "Shunt Active Filtering by Constant Power Load in Microgrid Based on IRP P-Q And CPC Reference Signal Generation Schemes," *IEEE Power System Technology (POWERCON) Conf.*, Nov. 2012, pp. 1–6.
- [118] H. H. Zeineldin, and J. L. Jr. Kirtley, "Micro-Grid Operation of Inverter Based Distributed Generation with Voltage and Frequency Dependent Loads," *IEEE Power & Energy Society General Meeting*, Jul. 2009, pp. 1–6.
- [119] AH. Kasem Alaboudy, H. H. Zeineldin, J. L. Kirtley, "Microgrid Stability Characterization Subsequent to Fault-Triggered Islanding Incidents," *IEEE Trans. Power Del.*, vol. 27, no. 2, pp. 658–669, Apr. 2012.

- [120] R. Majumder, B. Chaudhuri, A. Ghosh, R. Majumder, G. Ledwich, and F. Zare, "Improvement of Stability and Load Sharing in an Autonomous Microgrid Using Supplementary Droop Control Loop," *IEEE Trans. Power Delivery*, vol. 25, no. 2, pp. 796–808, May 2010.
- [121] A. Etemadi, E. Davison, and R. Iravani, "A Decentralized Control Strategy for Multi-DER Microgrids Part I-Fundamental Concept," *IEEE Trans. Power Delivery*, vol. 27, no. 4, pp. 1843–1853, Oct. 2012.
- [122] S. M. Amelian, and R. Hooshmand, "Small Signal Stability Analysis of Microgrids Considering Comprehensive Load Models - A Sensitivity Based Approach," *IEEE Smart Grid Conf. (SGC)*, Dec. 2013, pp. 143–149.
- [123] X. Lu, J. M. Guerrero, and K. Sun, "An Improved Droop Control Method for DC Microgrids Based on Low Bandwidth Communication With DC Bus Voltage Restoration and Enhanced Current Sharing Accuracy," *IEEE Trans. Power Electron.*, vol. 29, no. 4, pp. 1800–1813, Apr. 2014.
- [124] T. L. Vandoorn, B. Meersman, J. D. M. D. Kooning, and L. Vandeveld, "Analogy Between Conventional Grid Control and Islanded Microgrid Control Based on a Global DC-Link Voltage Droop," *IEEE Trans. Power Del.*, vol. 27, no. 3, pp. 1405–1414, Jul. 2012.
- [125] D. Niyato, L. Xiao, and P. Wang, "Machine-To-Machine Communications for Home Energy Management System in Smart Grid," *IEEE Commun. Mag.*, vol. 49, pp. 53–59, Apr. 2011.
- [126] V. C. Gungor, B. Lu, and G. P. Hancke, "Opportunities and Challenges of Wireless Sensor Networks in Smart Grid," *IEEE Trans. Ind. Electron.*, vol. 57, pp. 3557–3564, Oct. 2010.
- [127] R. C. Qiu, H. Zhen, Ch. Zhe, G. Nan, R. Ranganathan, H. Shujie, and Zh. Gang, "Cognitive Radio Network for the Smart Grid: Experimental System Architecture, Control Algorithms, Security, and Microgrid Testbed," *IEEE Trans. Smart Grid*, vol. 2, no. 4, pp. 724–740, Dec. 2011.
- [128] S. Galli, A. Scaglione, and Z. Wang, "Power Line Communications and the Smart Grid," in *Proc. Int. Conf. Smart Grid Communications*, Gaithersburg, MD, Oct. 2010, pp. 303–308.
- [129] N. Pavlidou, A. J. H. Vinck, J. Yazdani, and B. Honary, "Smart Meters for Power Grid: Challenges, Issues, Advantages and Status," *Renewable Sustainable Energy Rev.*, vol. 15, no. 6, pp. 2736–2742, Aug. 2011.
- [130] L. K. Siow, P. L. So, H. B. Gooi, F. L. Luo, C. J. Gajanayake, Q. N. Vo, "Wi-Fi Based Server in Microgrid Energy Management System," *TENCON 2009 - 2009 IEEE Region 10 Conference*, vol. 1, no. 1, pp. 23–26 Jan. 2009.
- [131] E. Hossain, Z. Han, and H. V. Poor, Eds., *Smart Grid Communications and Networking*. Cambridge, U.K.: Cambridge Univ. Press, 2012.
- [132] C. Guzman, A. Cardenas, and K. Agbossou, "Load Sharing Strategy for Autonomous AC Microgrids Based on FPGA Implementation of ADALINE&FLL," *IEEE Trans. Energy Conv.*, vol. 29, no. 3, pp. 663–672, Sep. 2014.
- [133] A. Nagliero, R. A. Mastromauro, V. G. Monopoli, M. Liserre, A. Dell'Aquila, "Analysis of a universal inverter working in grid-connected, stand-alone and micro-grid," *IEEE International Symposium on Industrial Electronics (ISIE)*, pp. 650–657, July 2010.
- [134] Y. W. Li and C. N. Kao, "An Accurate Power Control Strategy for Power-Electronics-Interfaced Distributed Generation Units Operating in a Low-Voltage Multibus Microgrid," *IEEE Trans. Power Electron.*, vol. 24, pp. 2977–2988, Dec. 2009.
- [135] J. Rocabert, A. Luna, F. Blaabjerg, and P. Rodriguez, "Control of Power Converters in AC Microgrids," *IEEE Trans. Power Electron.*, vol. 27, no. 11, pp. 4734–4749, Nov. 2012.
- [136] R. Teodorescu, M. Liserre, and P. Rodriguez, *Grid Converters for Photovoltaic and Wind Power Systems*, IEEE, Wiley, 2011.
- [137] A. Camacho, M. Castilla, J. Miret, J. Vasquez, and E. Alarcón-Gallo, "Flexible voltage support control for three phase distributed generation inverters under grid fault," *IEEE Trans. Ind. Electron.*, vol. 60, no. 4, pp. 1429–1441, 2013.
- [138] P. Rodriguez, J. Pou, J. Bergas, J. I. Candela, R. P. Burgos, and D. Boroyevich, "Decoupled double synchronous reference frame PLL for power converters controls," *IEEE Trans. Power Electron.*, vol. 22, no. 2, pp. 584–592, Mar. 2007.
- [139] P. Rodriguez, A. Luna, I. Candela, R. Muijal, R. Teodorescu, and F. Blaabjerg, "Multiresonant frequency-locked loop for grid synchronization of power converters under distorted grid conditions," *IEEE Trans. Ind. Electron.*, vol. 58, no. 1, pp. 127–138, Jan. 2011.
- [140] Y. Wang and Y. W. Li "Grid Synchronization PLL Based on Cascaded Delayed Signal Cancellation," *IEEE Trans. Power Electron.*, vol. 26, pp. 1987–1997, Jul. 2011.



**Farzam Nejabatkhah** (S'09) received the B.Sc. and M.Sc. degrees (both with honors) in electrical engineering from University of Tabriz, Iran, in 2009 and 2011, respectively. He is currently Ph.D. student in University of Alberta, Canada.



**Yun Wei Li** (S'04–M'05–SM'11) received the B.Sc. in Engineering degree in electrical engineering from Tianjin University, Tianjin, China, in 2002, and the Ph.D. degree from Nanyang Technological University, Singapore, in 2006.

In 2005, Dr. Li was a Visiting Scholar with Aalborg University, Denmark. From 2006 to 2007, he was a Postdoctoral Research Fellow at Ryerson University, Canada. In 2007, he also worked at Rockwell Automation Canada before he joined University of Alberta, Canada in the same year. Since then, Dr. Li has been with University of Alberta, initially as an Assistant Professor and was promoted to be a Full Professor in 2015. His research interests include distributed generation, microgrid, renewable energy, high power converters and electric motor drives. He serves as an Associate Editor for IEEE Transactions on Power Electronics and IEEE Transactions on Industrial Electronics. Dr. Li received the 2013 Richard M. Bass Outstanding Young Power Electronics Engineer Award from IEEE Power Electronics Society.